




TOP VIEW

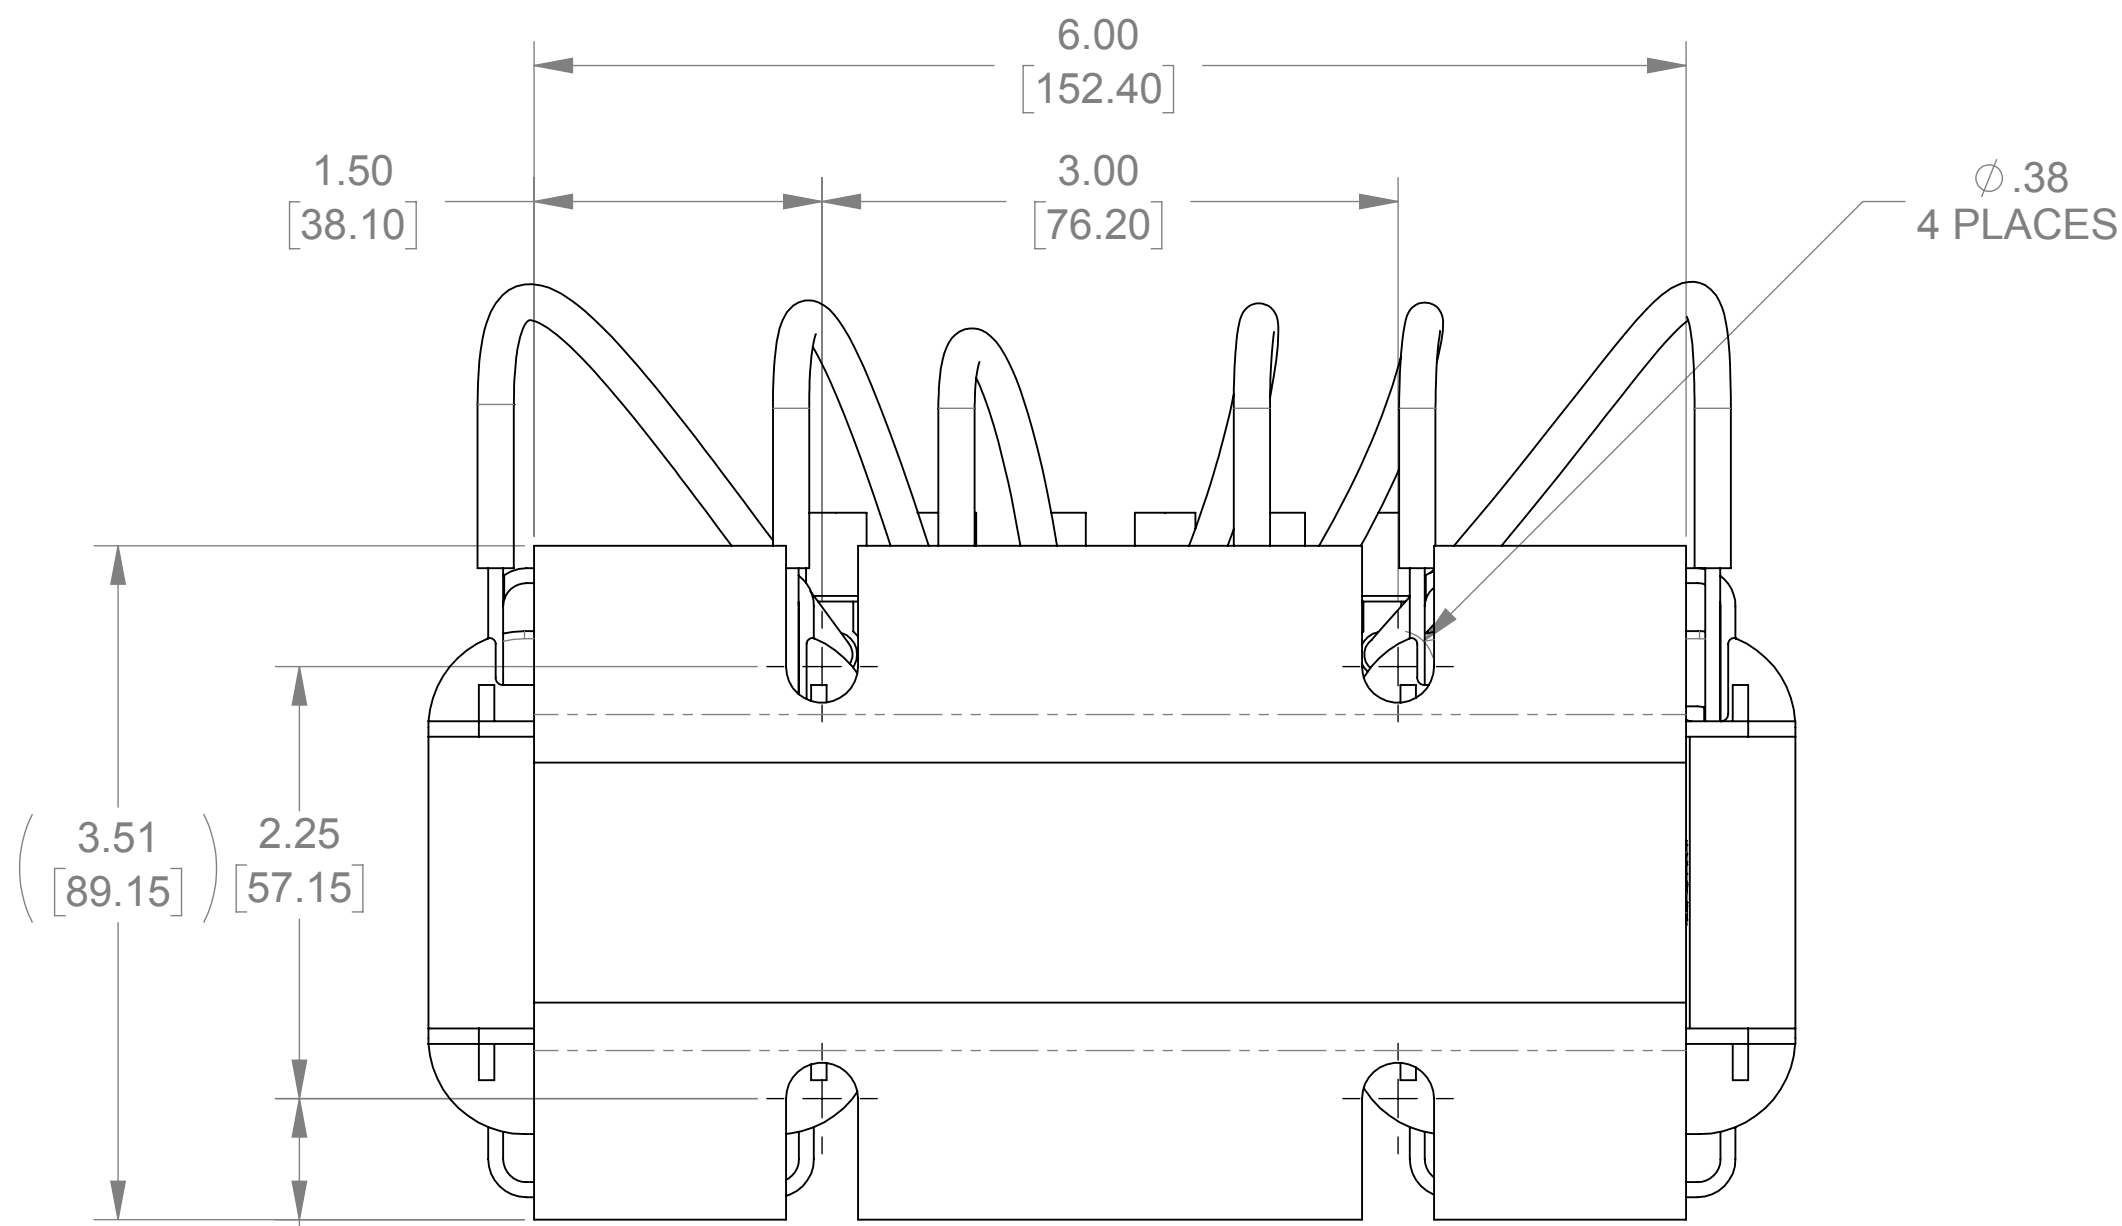

BOTTOM VIEW

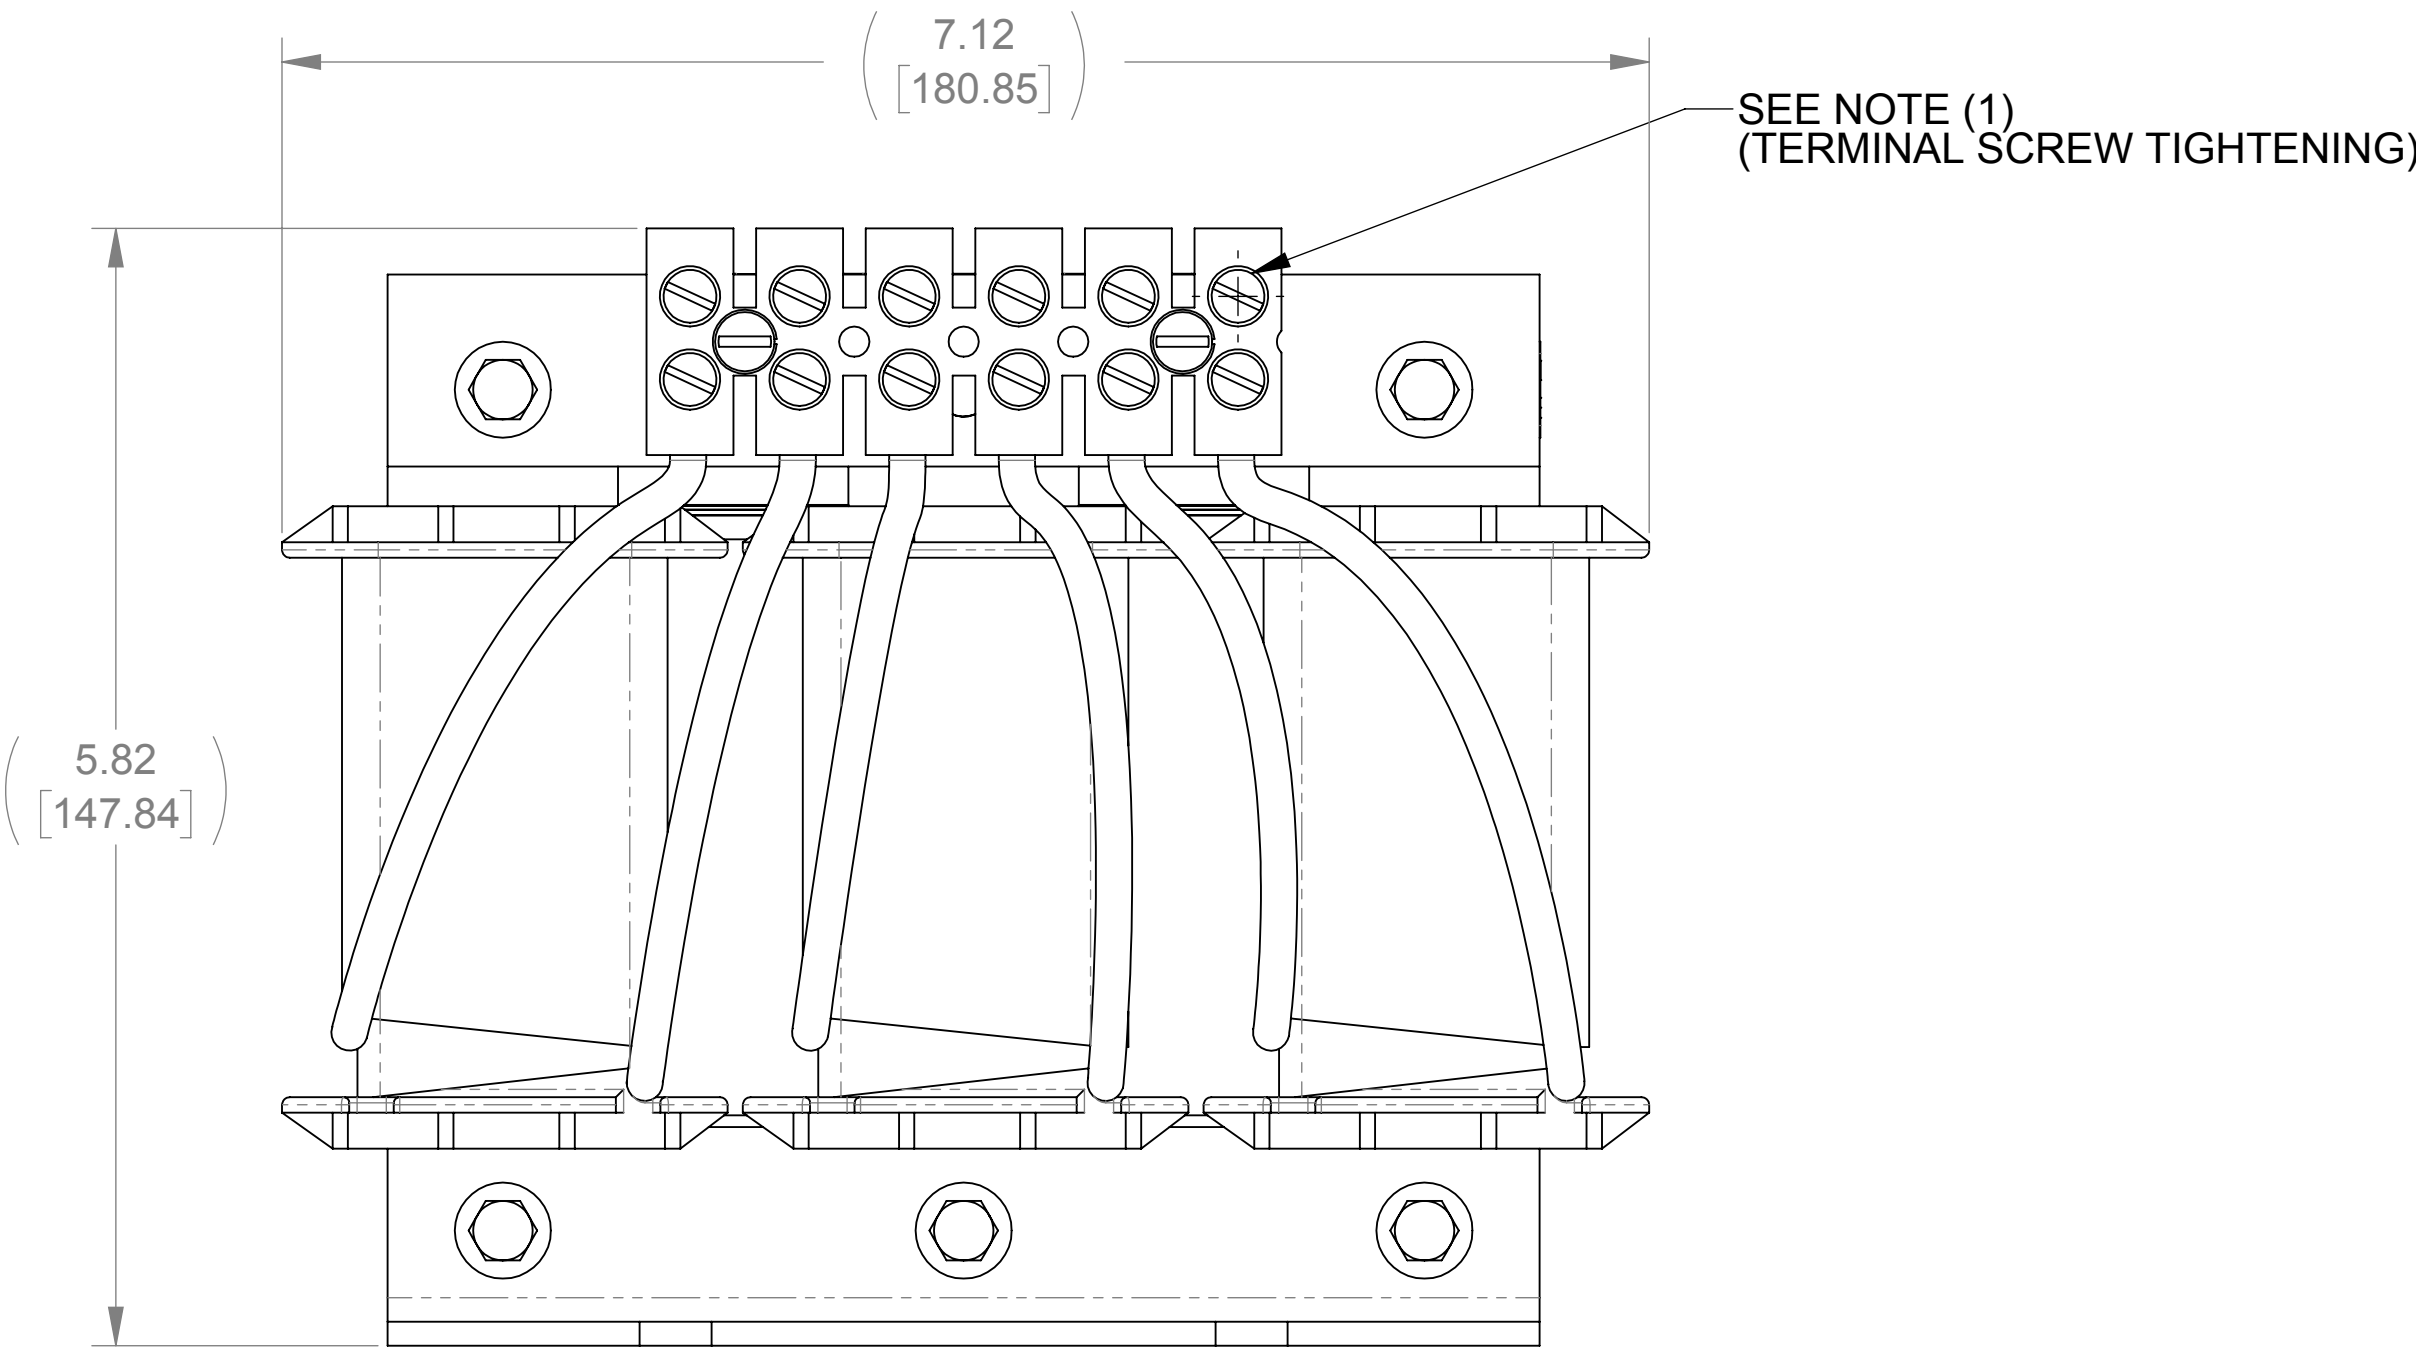

FRONT VIEW

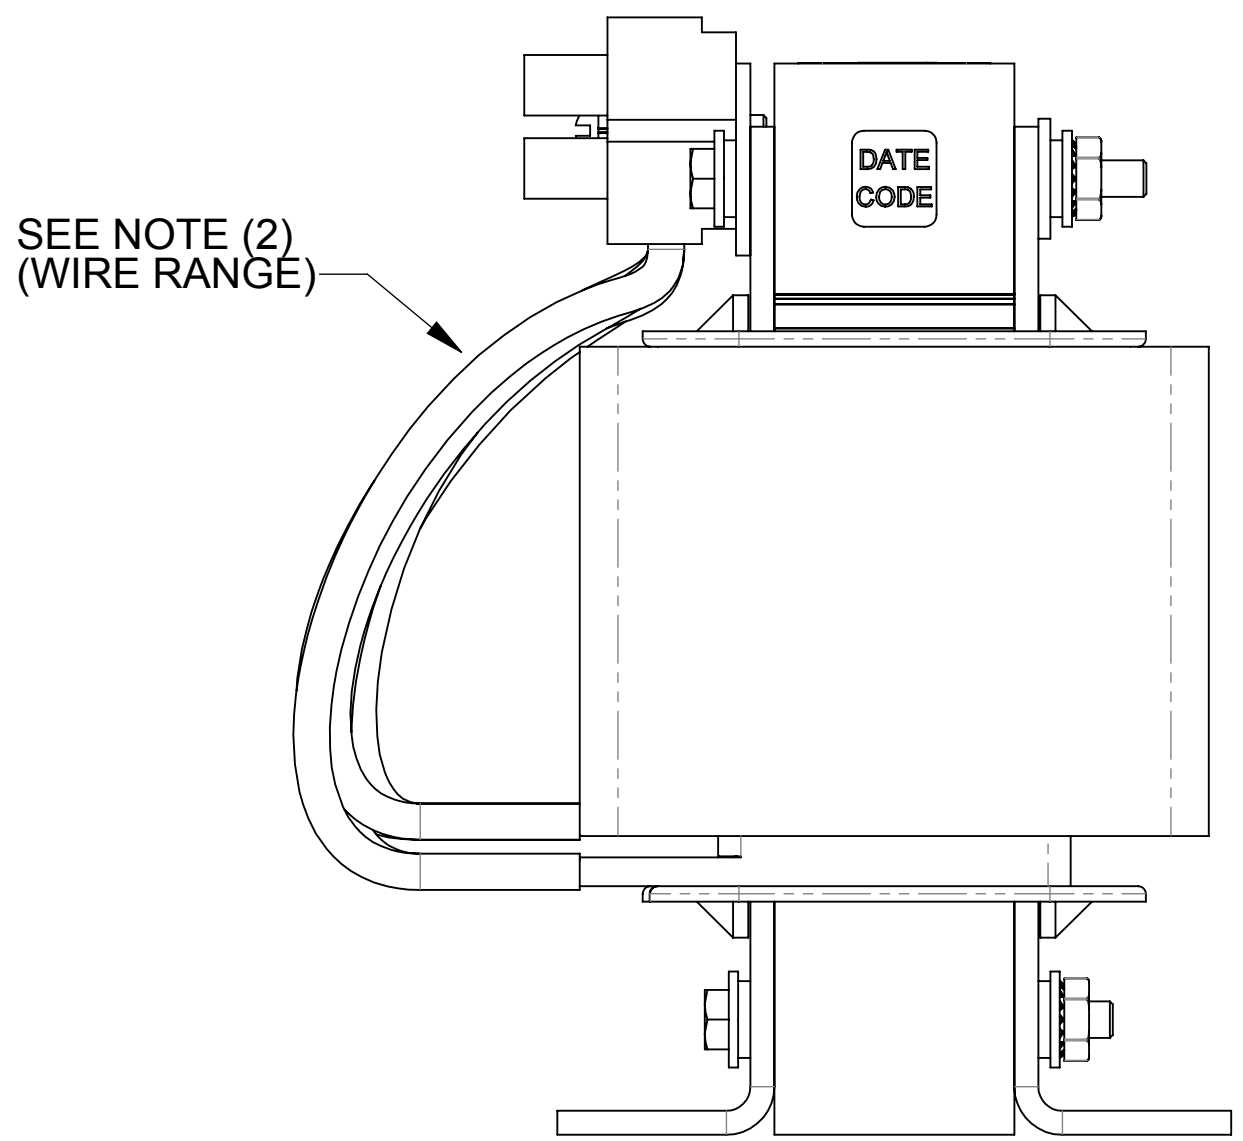

SIDE VIEW

NOTES:

- 1. TERMINAL SCREW TIGHTENING TORQUE: 16 in-lbs MAX
- 2. WIRE RANGE: 14 - 6 AWG

THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU(EUROPEAN UNION) DIRECTIVE RoHS2		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION		
CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION						
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES [MM] TOLERANCES ARE: ANGLES: ± 1 ° 1 PLACE .X: ± .1 [2.5] 2 PLACE .XX: ± .03 [0.76] 3 PLACE .XXX: ± .010 [0.254]		 N83 W13330 Leon Road Menomonee Falls, WI 53051 USA 800.455.4683 262.253.8200		DRAWN JP DATE 09/10/12		
CHECKED CR DATE 11/06/18						
APPROVED JG DATE 11/07/18						
SCALE 4:4						
				DESCRIPTION 3 PHASE REACTOR		
				SIZE D	DWG No. CD RLW-003503	REV 03
				SHEET 1 OF 1		