
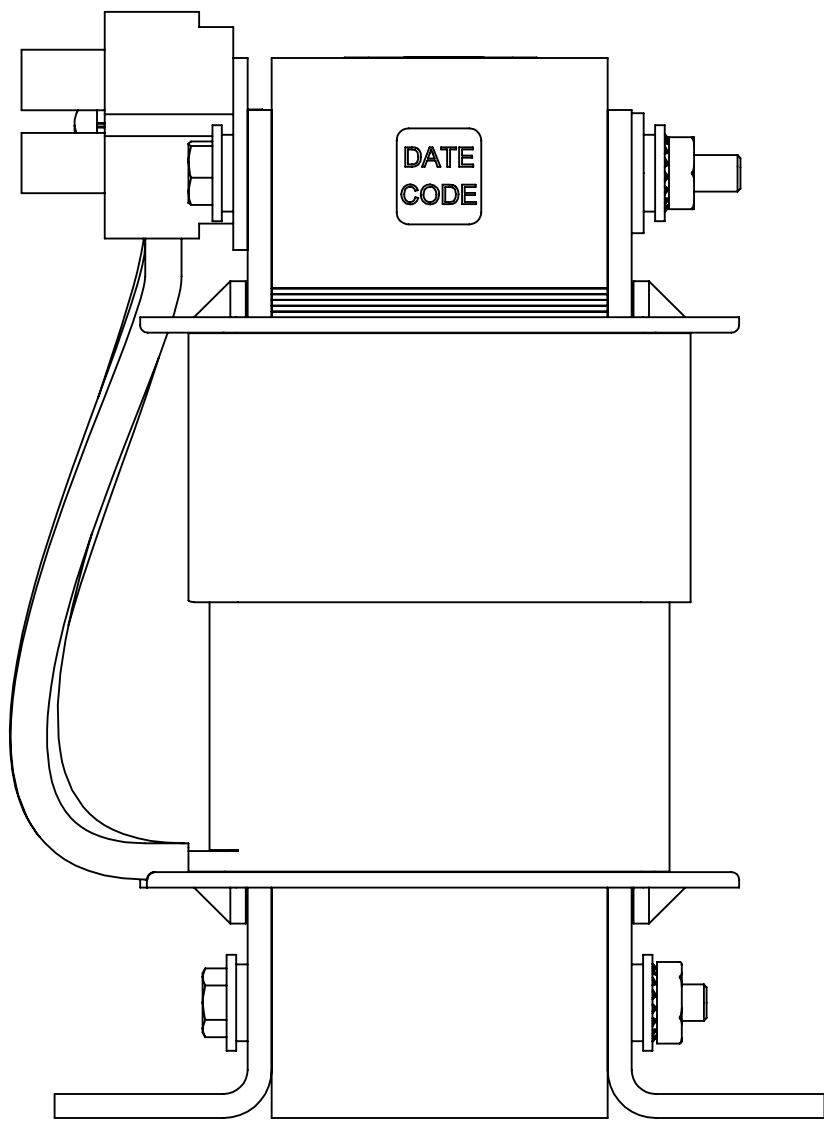
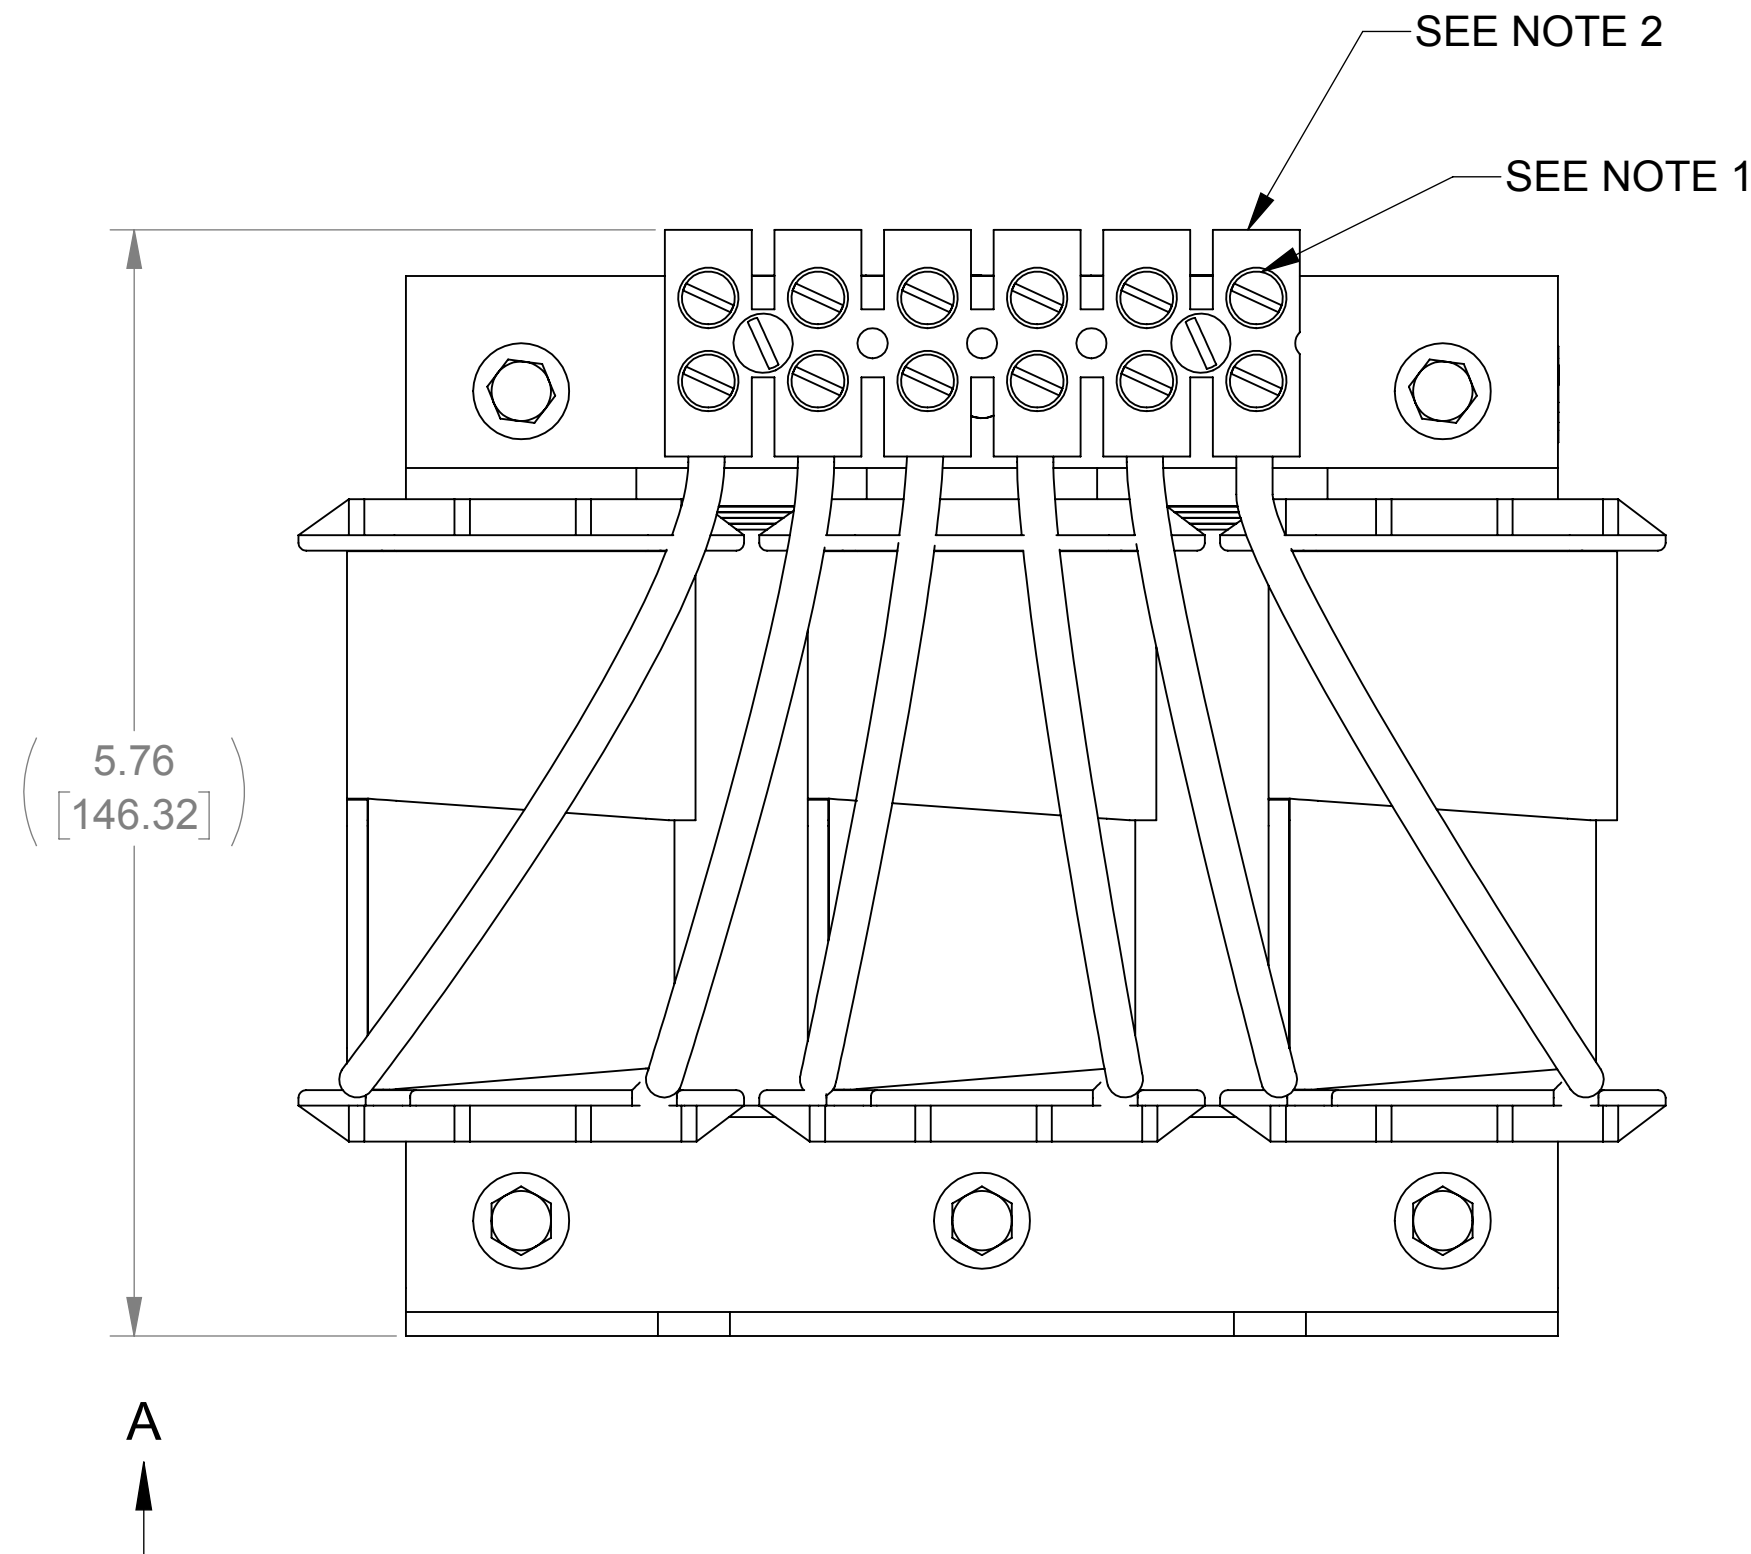
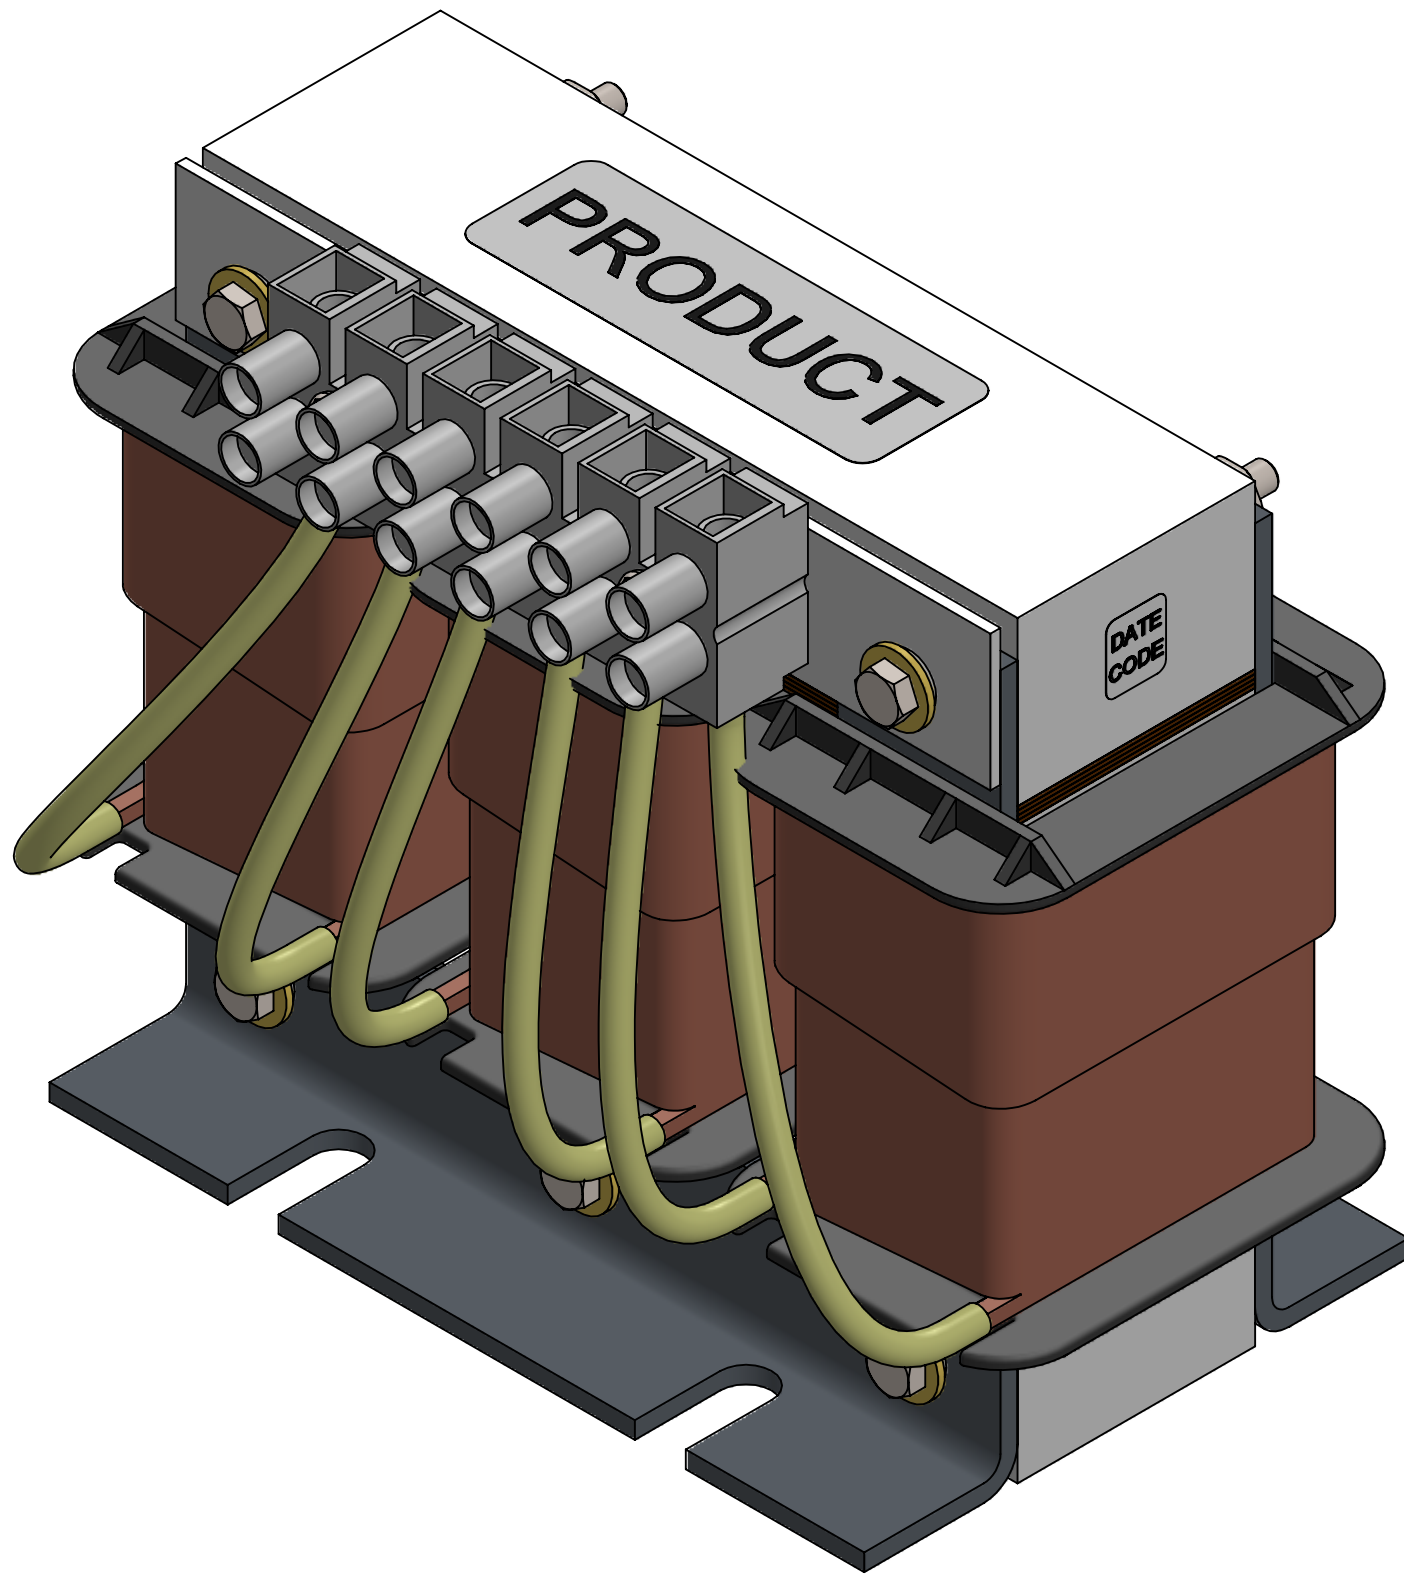
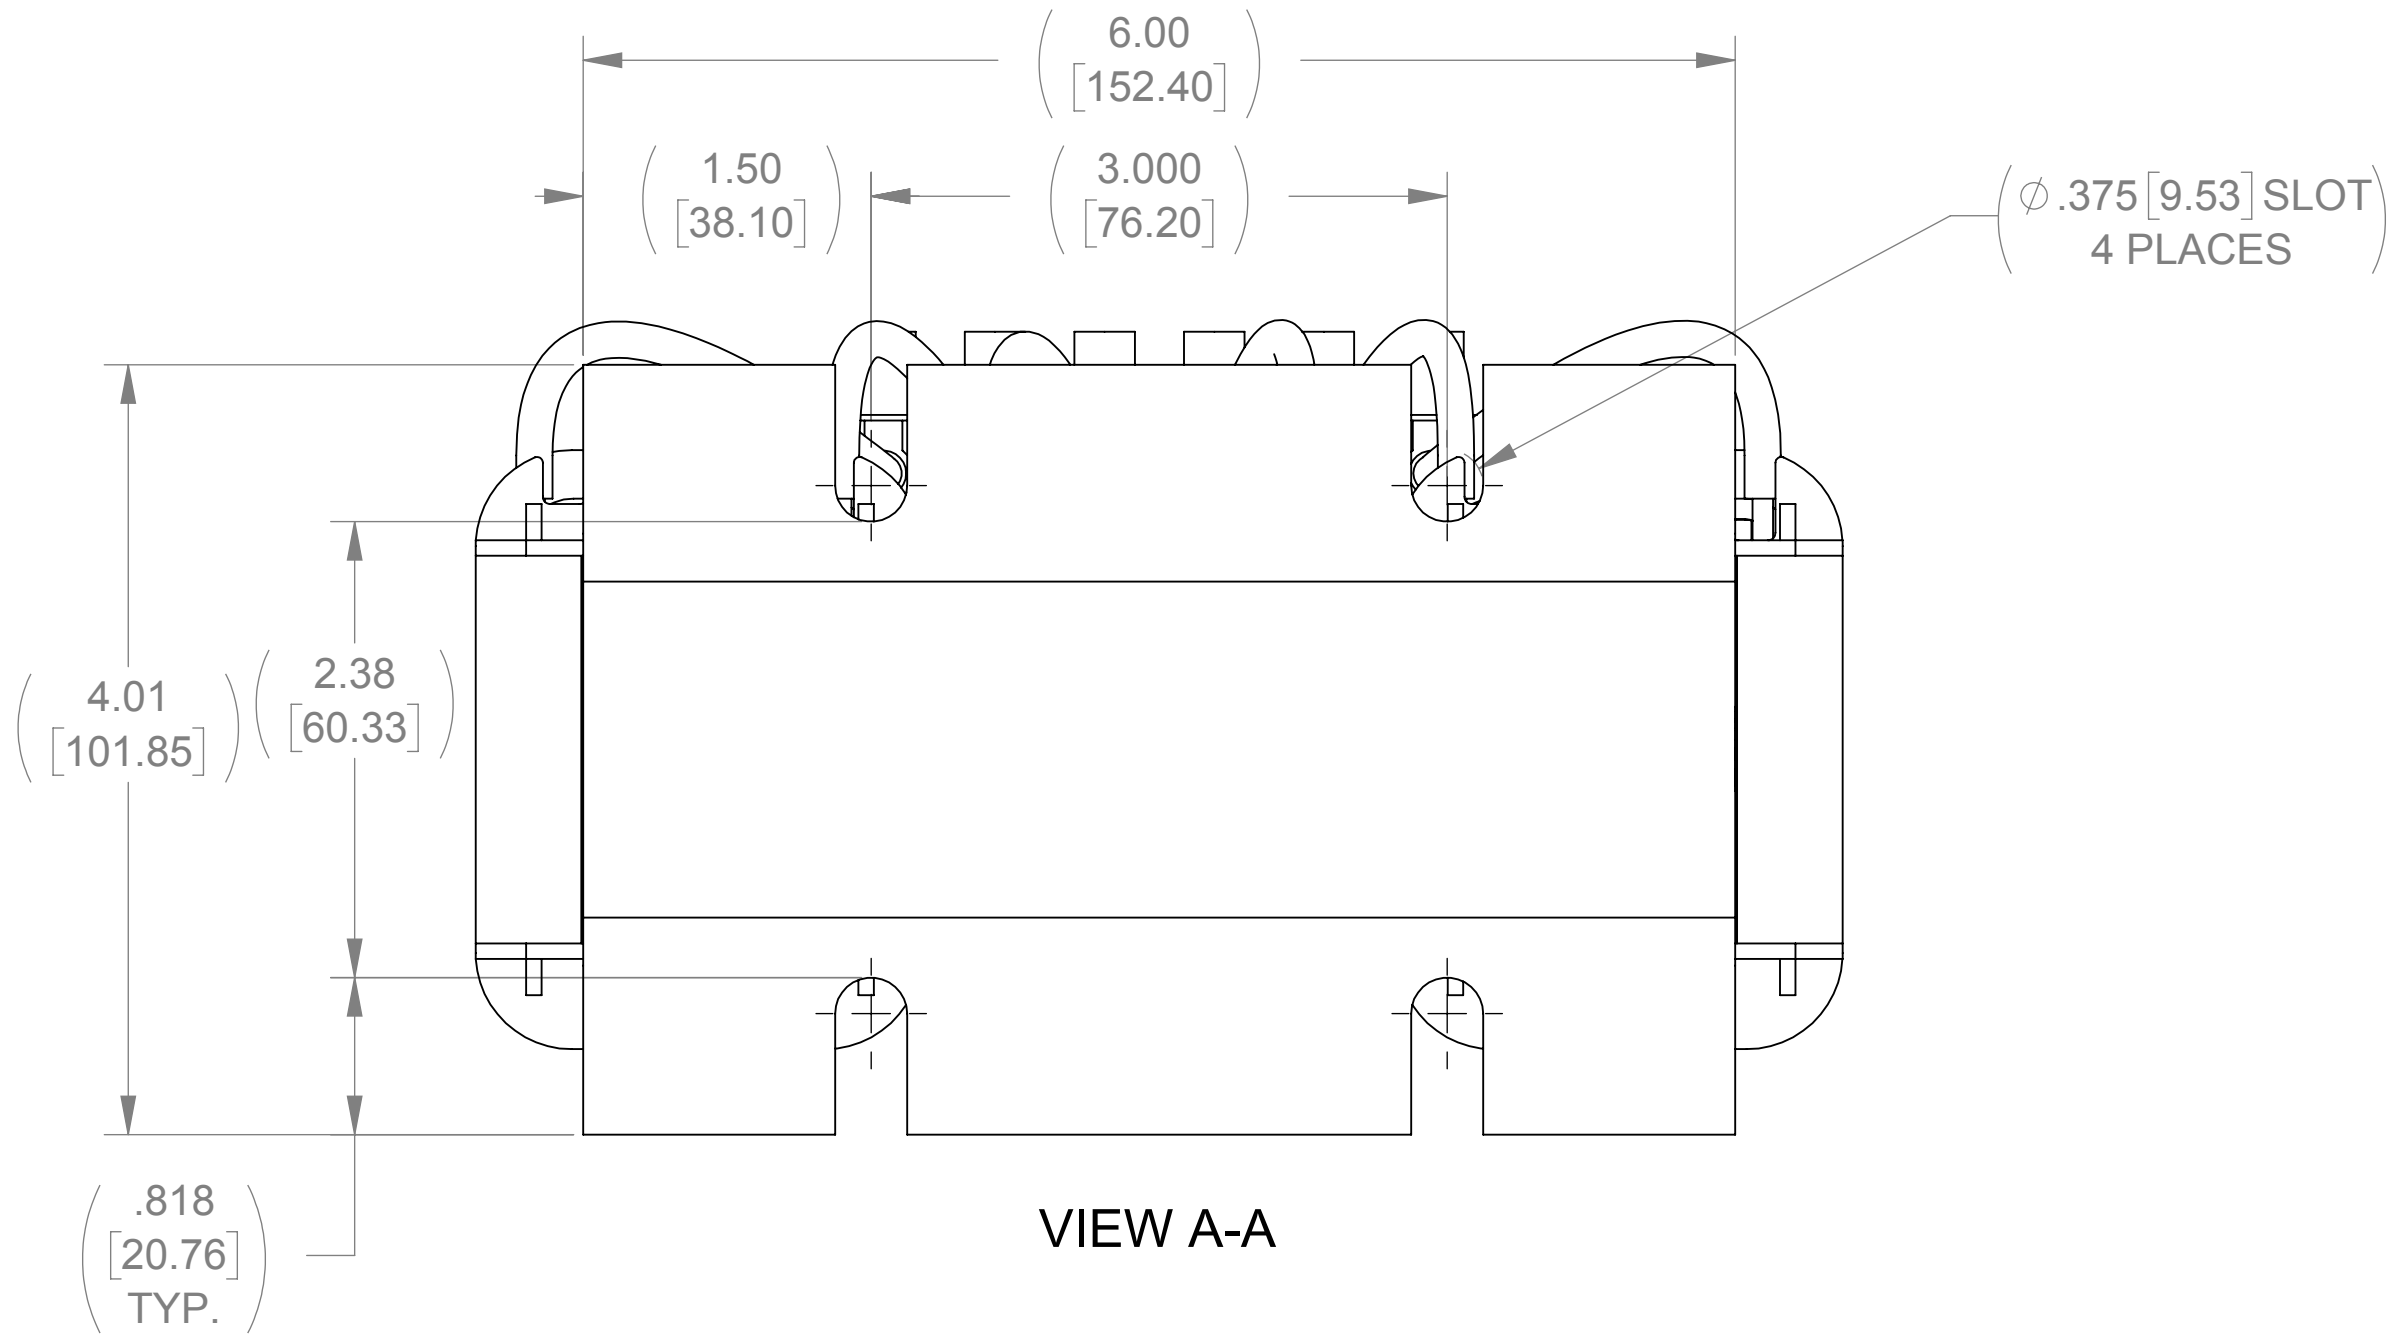


APPROX. WEIGHT (LBS)	INDUCTANCE	LOSS (WATTS)
18	1.20mH	122

ECO No	DESCRIPTION	REV BY	DATE
M11802	UPDATE TO CURRENT STANDARD, UPDATE TO MODIFIED COIL	MN	07/01/19

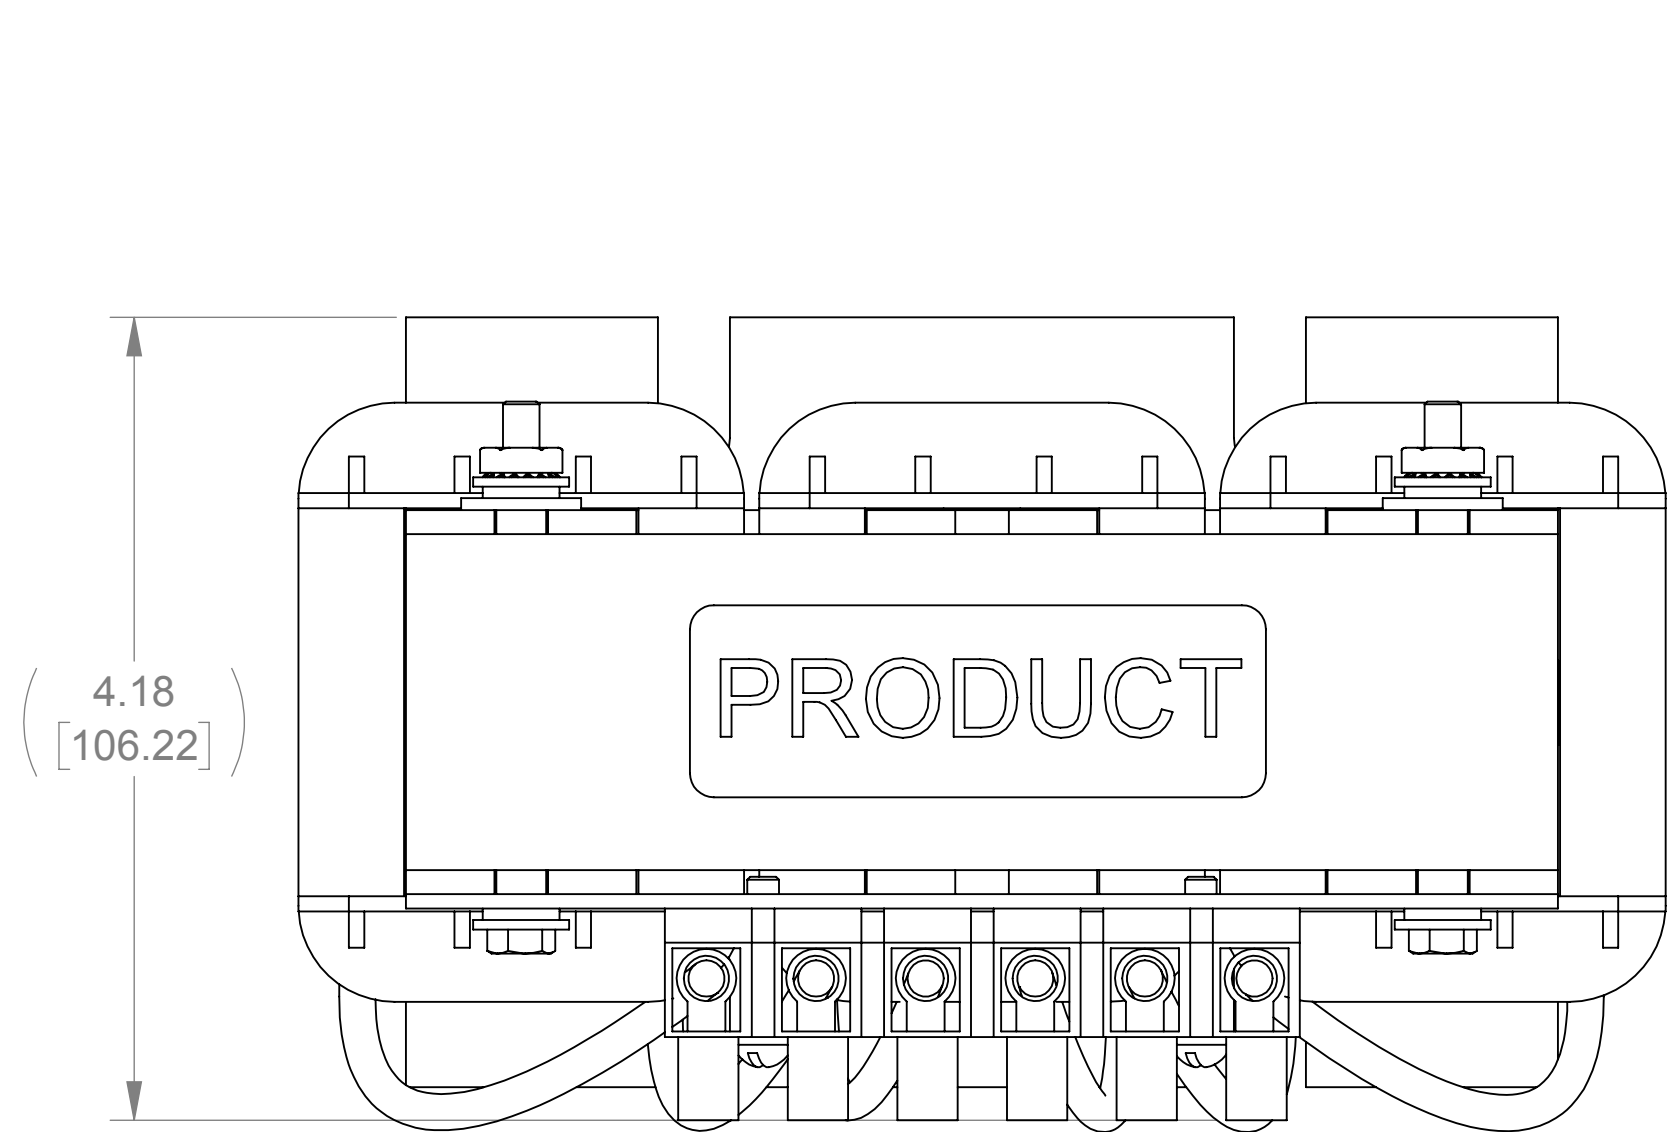

NOTES:

1. TERMINAL SCREW TIGHTENING TORQUE: 16 IN/LBS.
2. WIRE RANGE: 14 - 6 AWG.

THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU(EUROPEAN UNION) DIRECTIVE RoHS2		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION	
CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION				DESCRIPTION	
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES [MM] TOLERANCES ARE: ANGLES: ± 1 ° 1 PLACE .X: ± .1 [2.5] 2 PLACE .XX: ± .03 [0.76] 3 PLACE .XXX: ± .010 [0.254]		MTE POWER QUALITY. SOLVED. N83 W13330 Leon Road Menomonee Falls, WI 53051 USA 800.455.4683 262.253.8200		LINE REACTOR	
DRAWN JP		DATE 09/10/12		SIZE D	
CHECKED MN		DATE 07/01/19		DWG No. CD RLW-003505	
APPROVED RH		DATE 07/01/19		REV 06	
SCALE 4:4				SHEET 1 OF 1	