
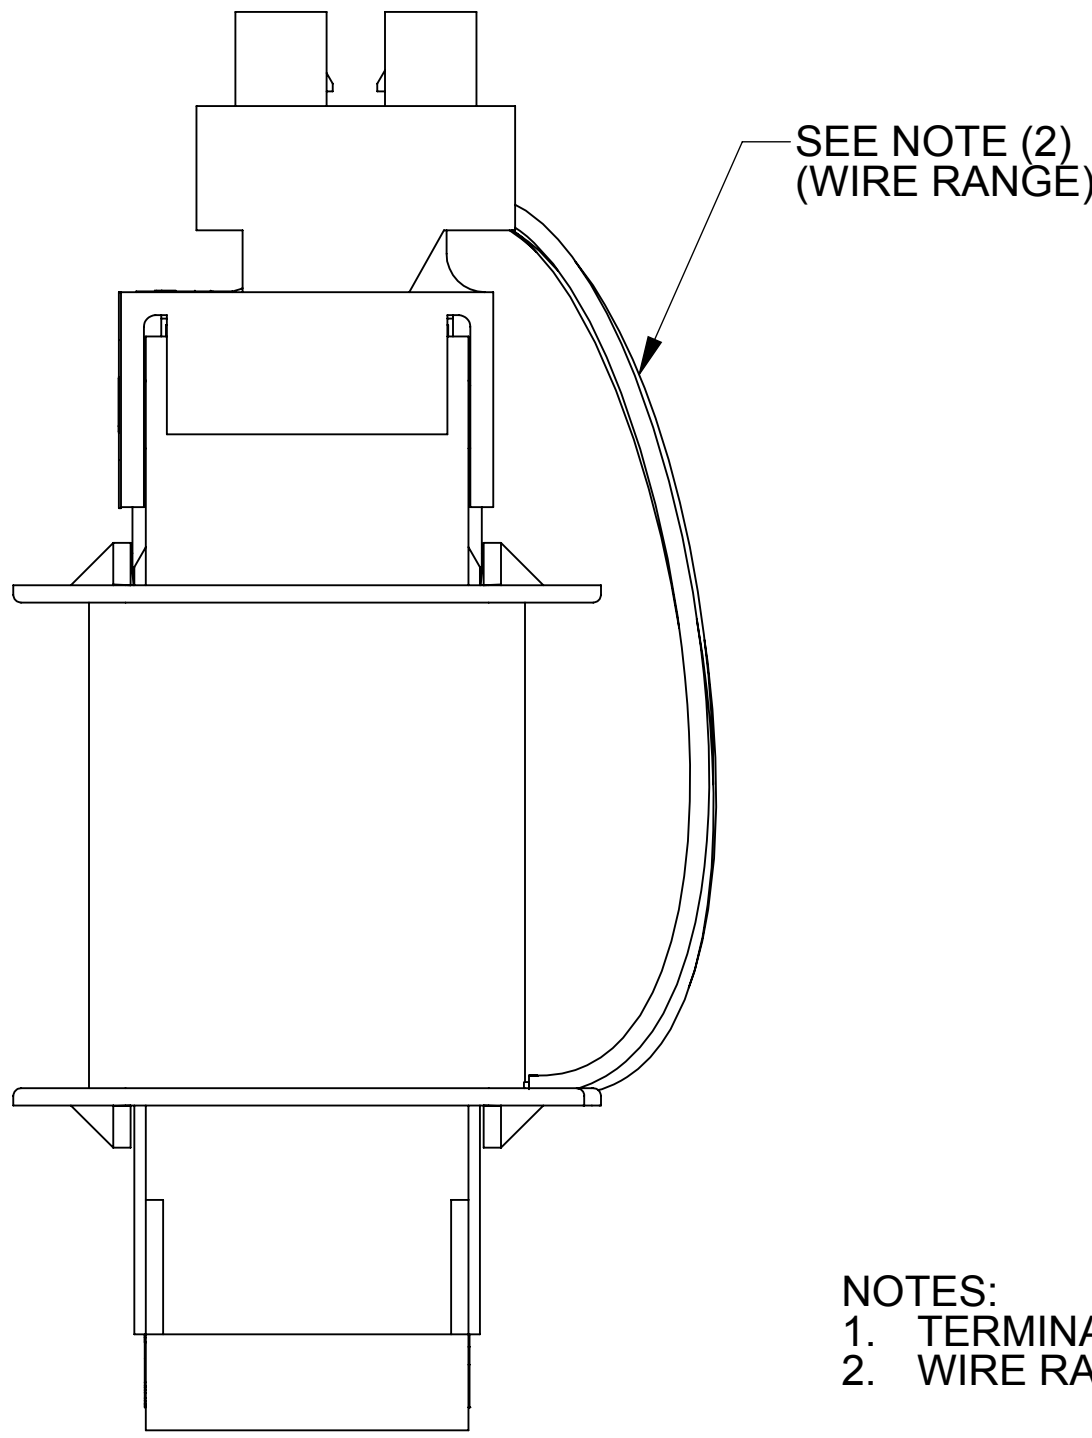



VIEW A-A

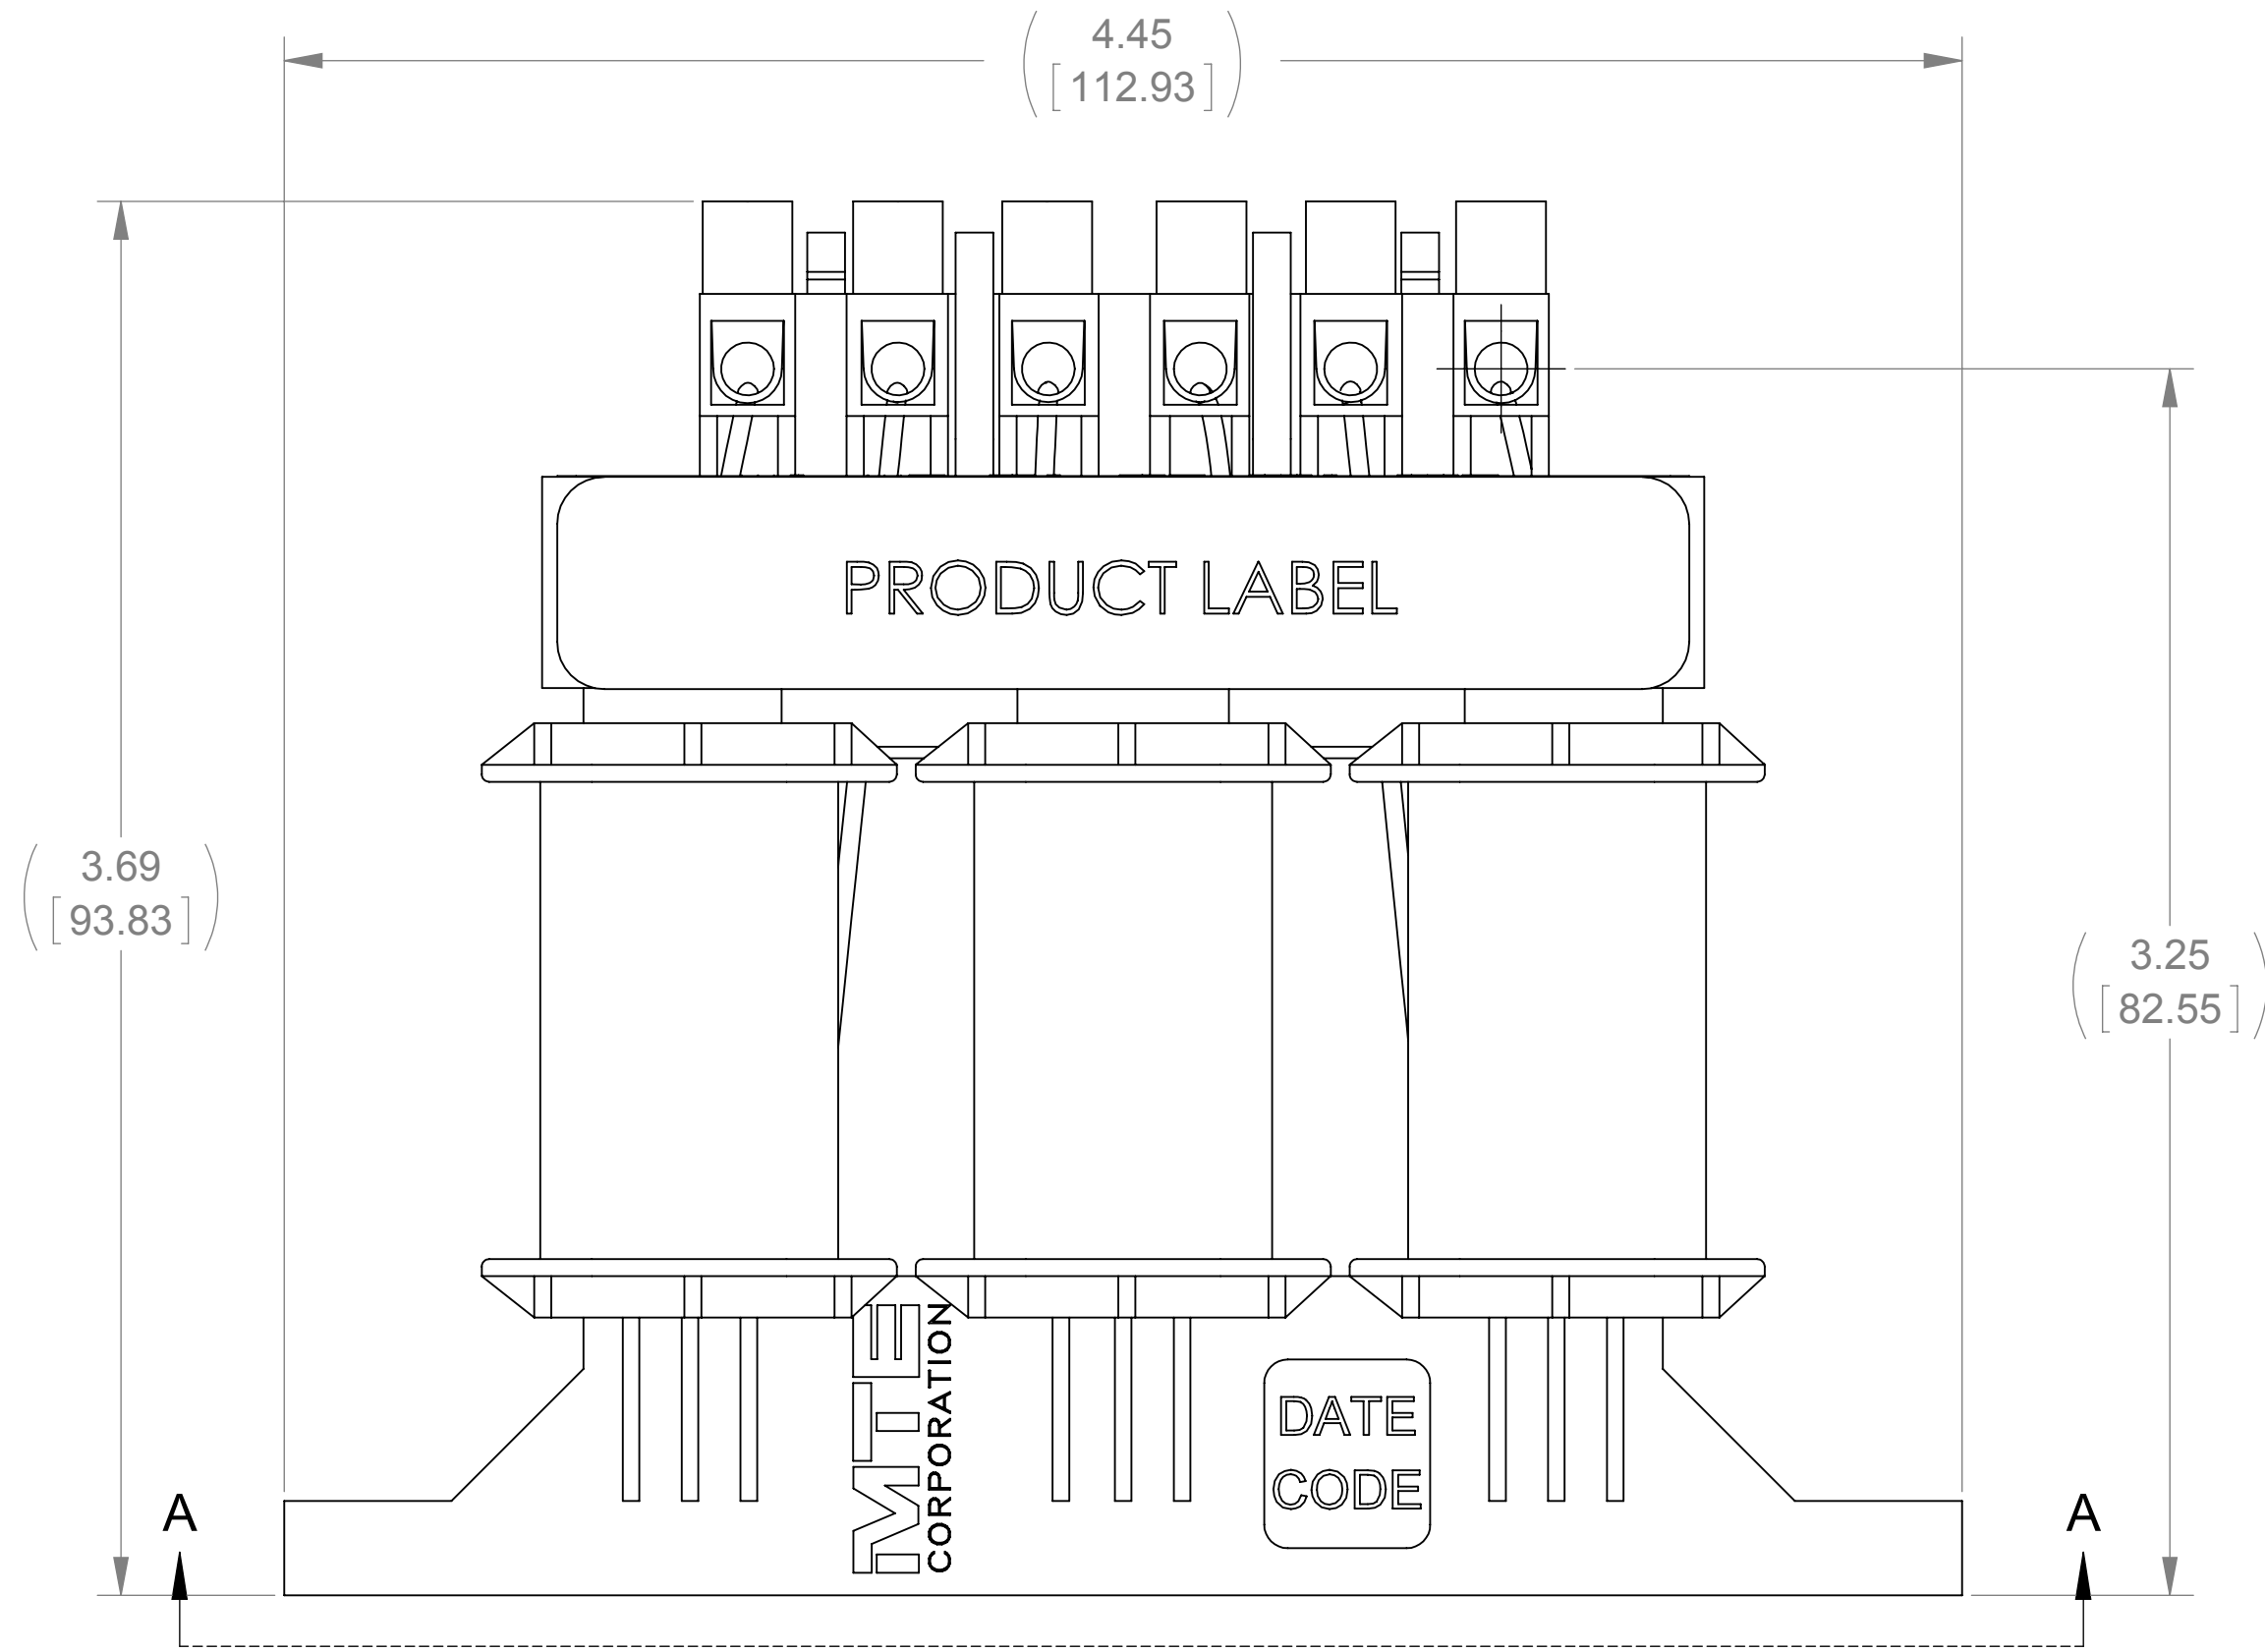

- NOTES:
1. TERMINAL SCREW TIGHTENING TORQUE; 4.5 in-lb MAX.
2. WIRE RANGE: 22-10 AWG.

THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU(EUROPEAN UNION) DIRECTIVE RoHS		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION					
CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION				DESCRIPTION					
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES [MM] TOLERANCES ARE: ANGLES: ± 1 ° 1 PLACE .X: ± .1 [2.5] 2 PLACE .XX: ± .03 [0.76] 3 PLACE .XXX: ± .010 [0.254]		 N83 W13330 Leon Road Menomonee Falls, WI 53051 USA 800.455-4683 262.253.8200		SNAP CHANNEL REACTOR					
		DRAWN	DATE	SIZE D		DWG No. CD RLW-01P605		REV 04	
		JP	07/31/12						
		CHECKED	DATE						
		JH	08/07/12						
		APPROVED	DATE						
		JH	08/07/12	SCALE 2:1				SHEET 1 OF 1	