

APPROX. WEIGHT  
(LBS.)  
42









ECO No	DESCRIPTION	REV BY	DATE
M10014	ADDED MOUNTING BRACKET OT REACTOR	MN	11/29/16

D


C

B

A

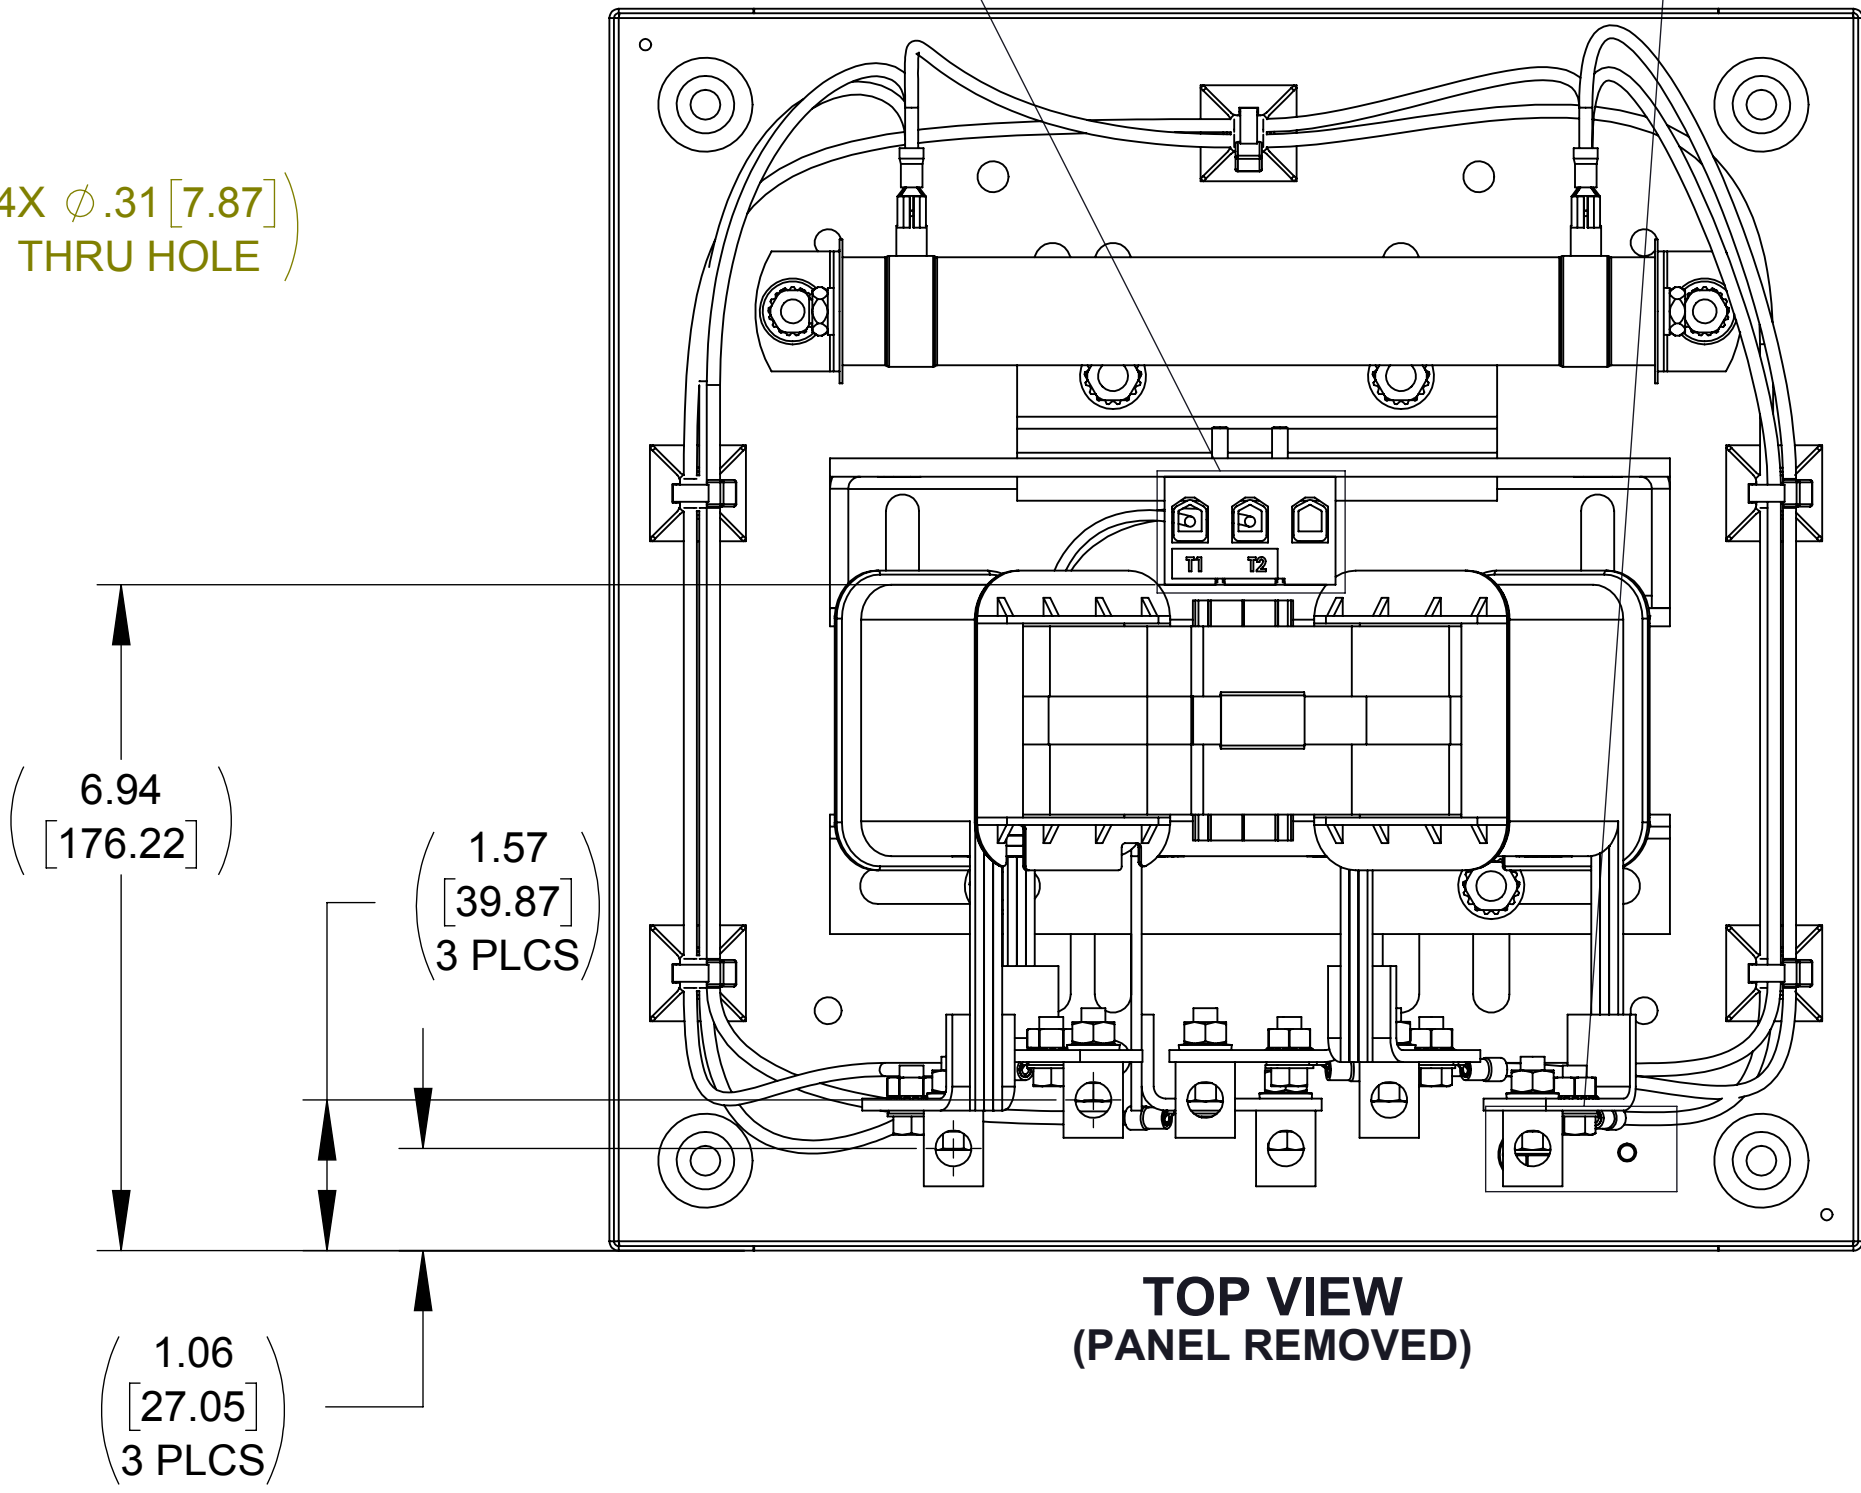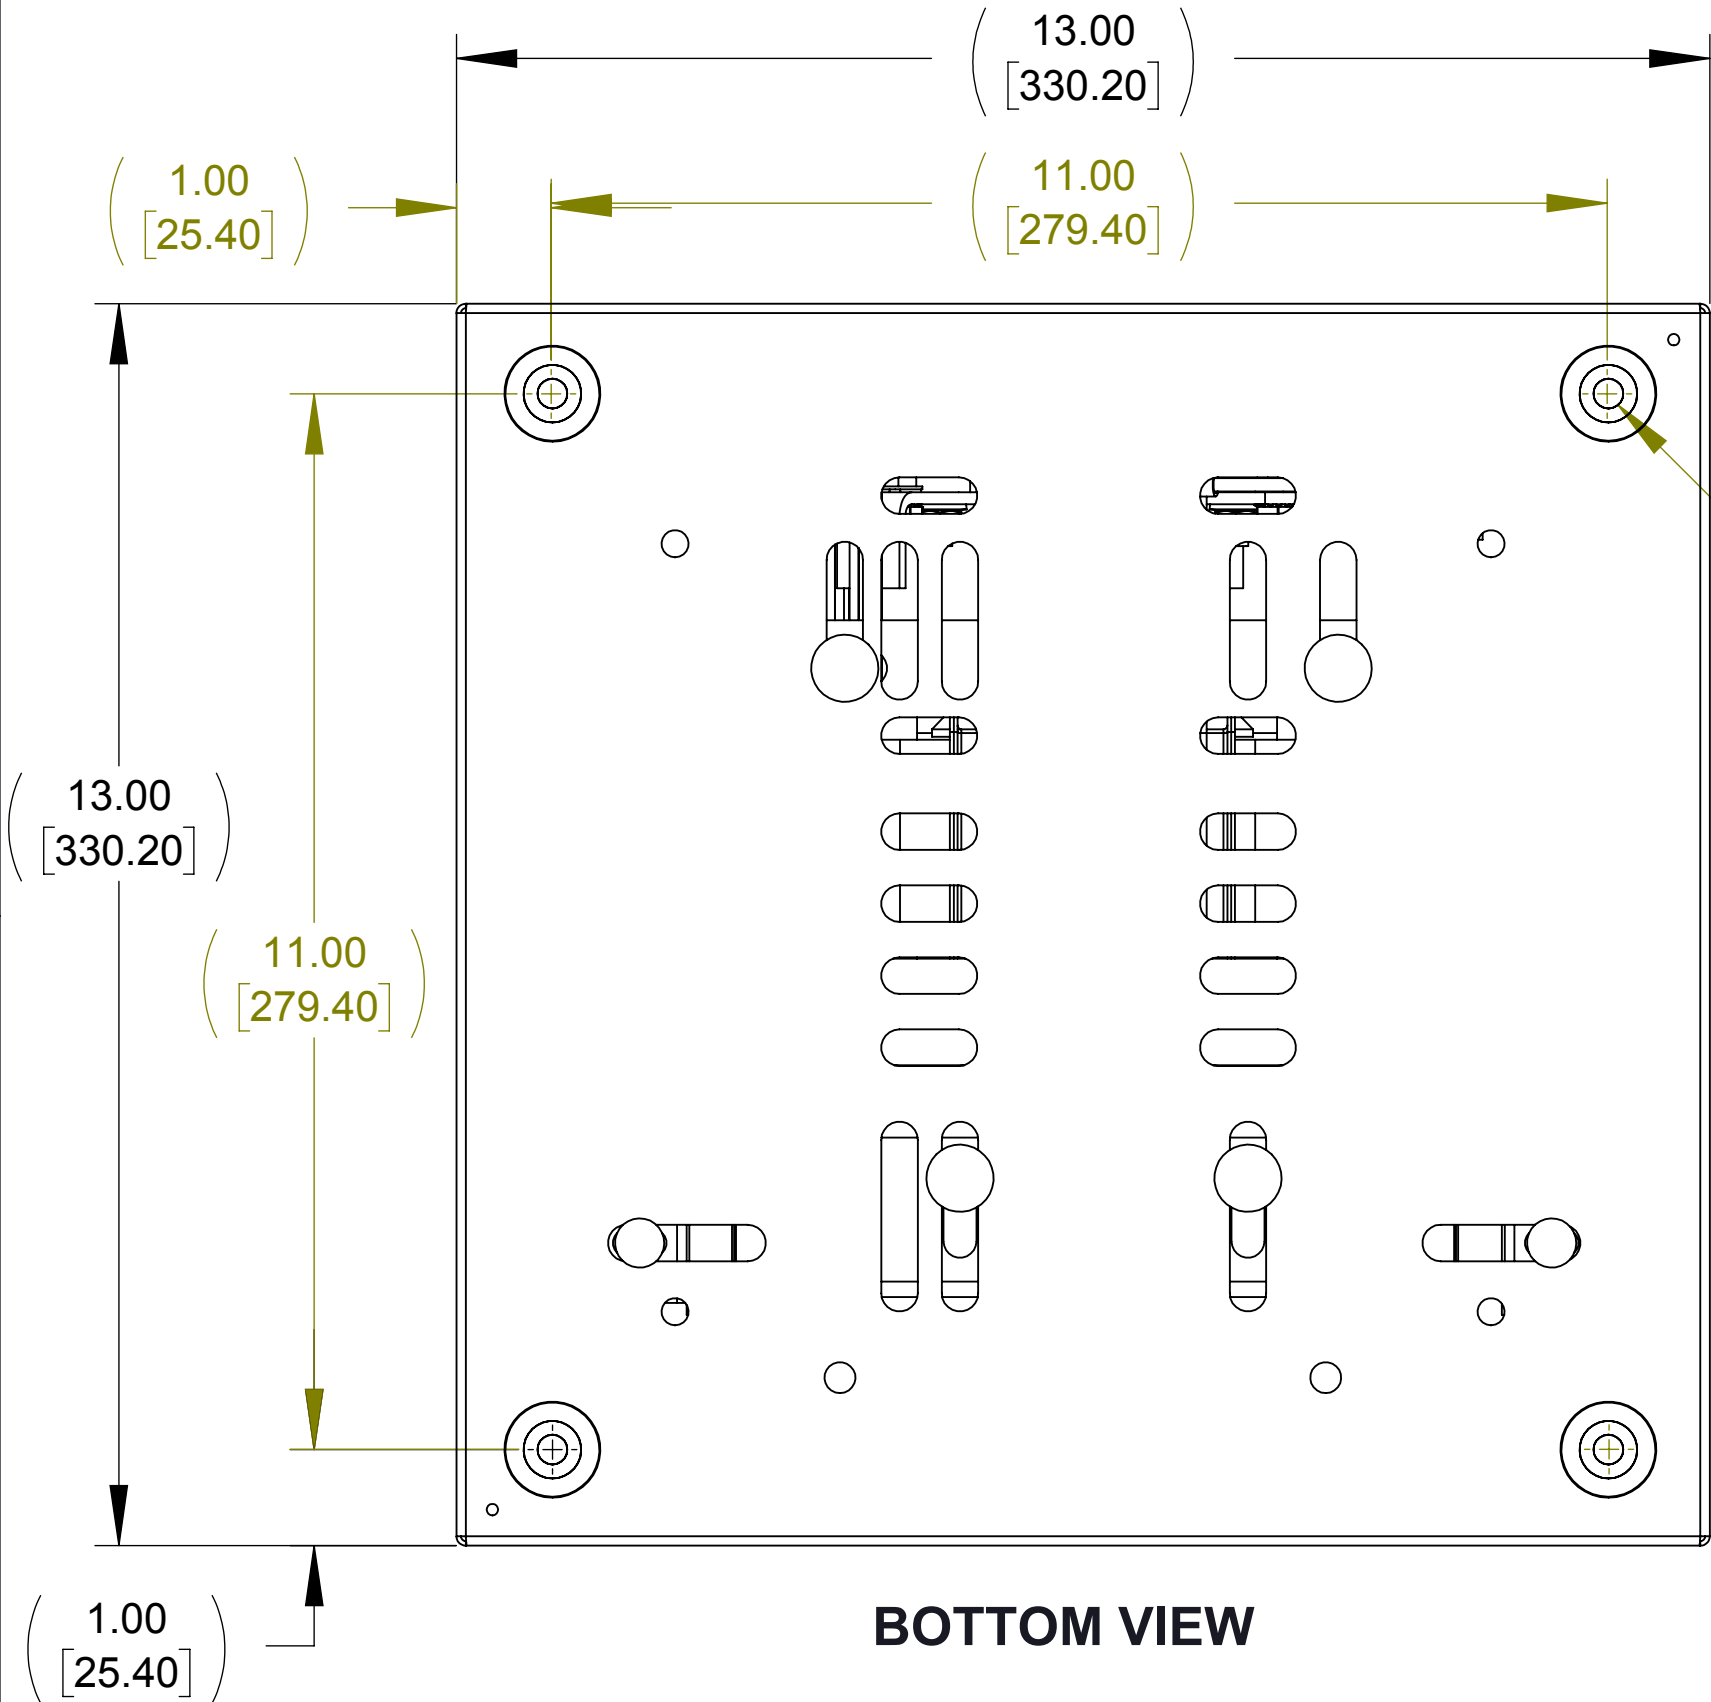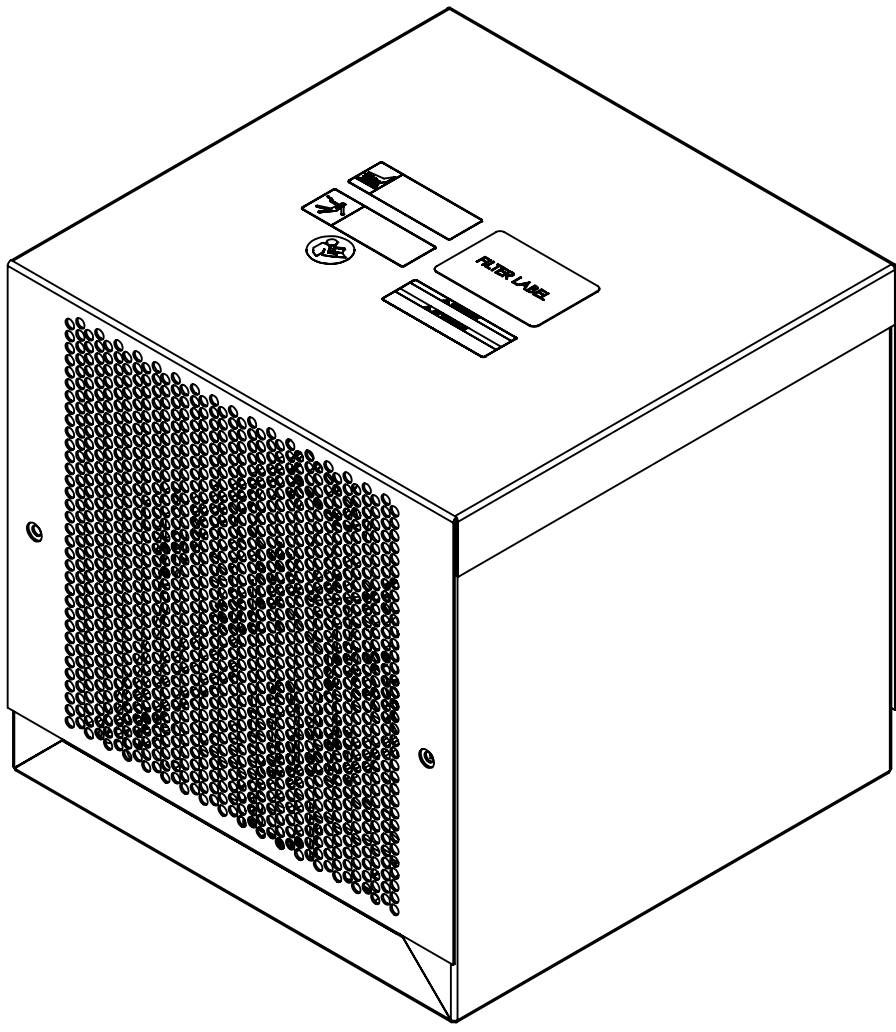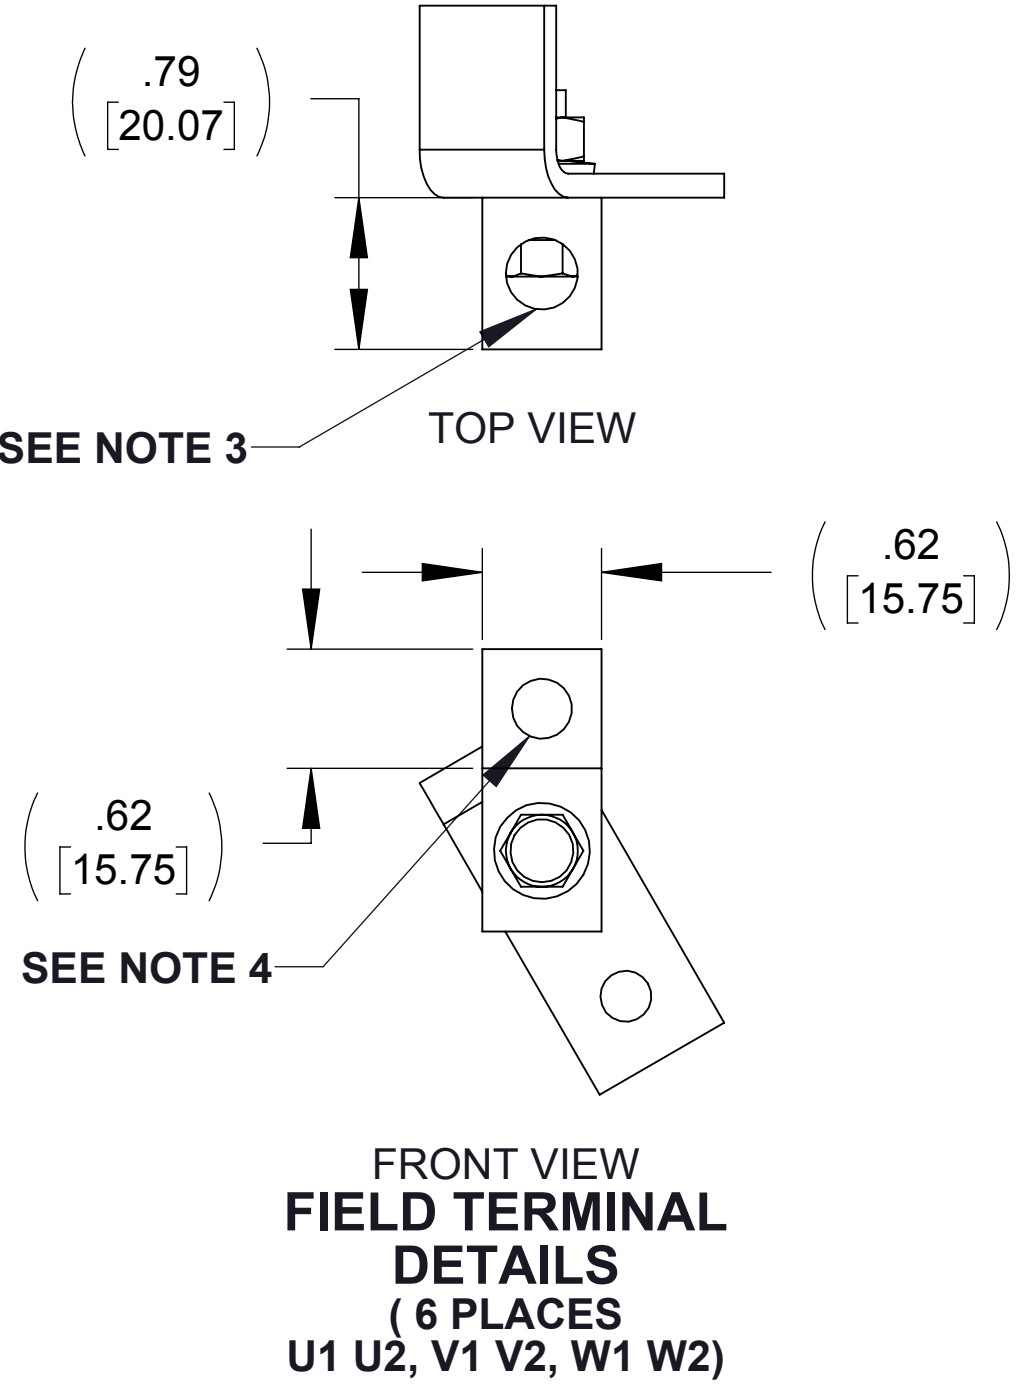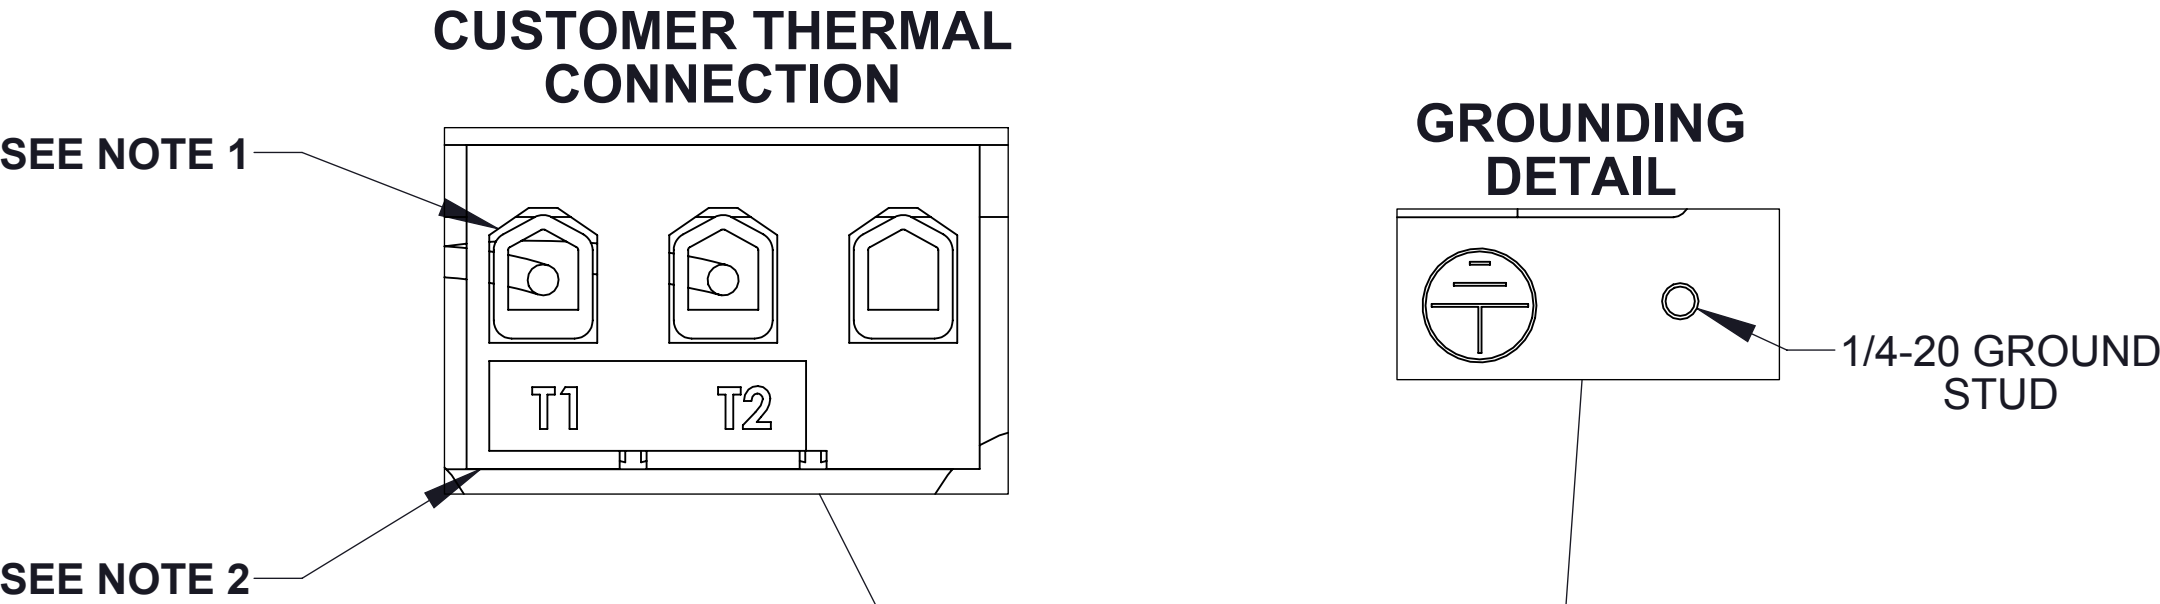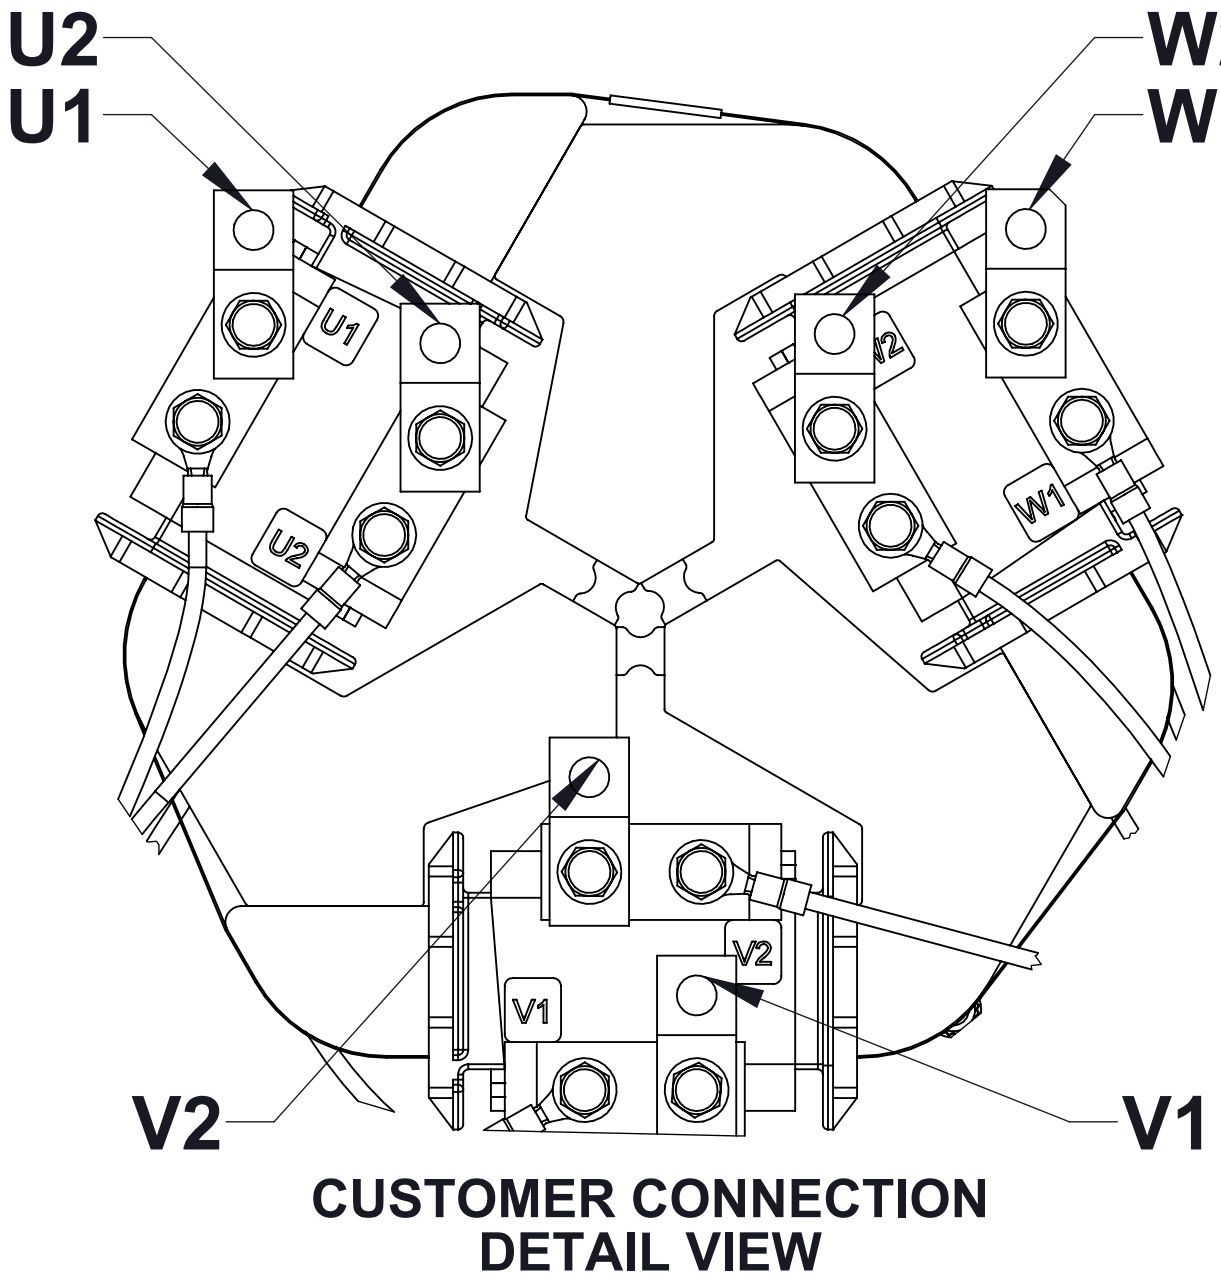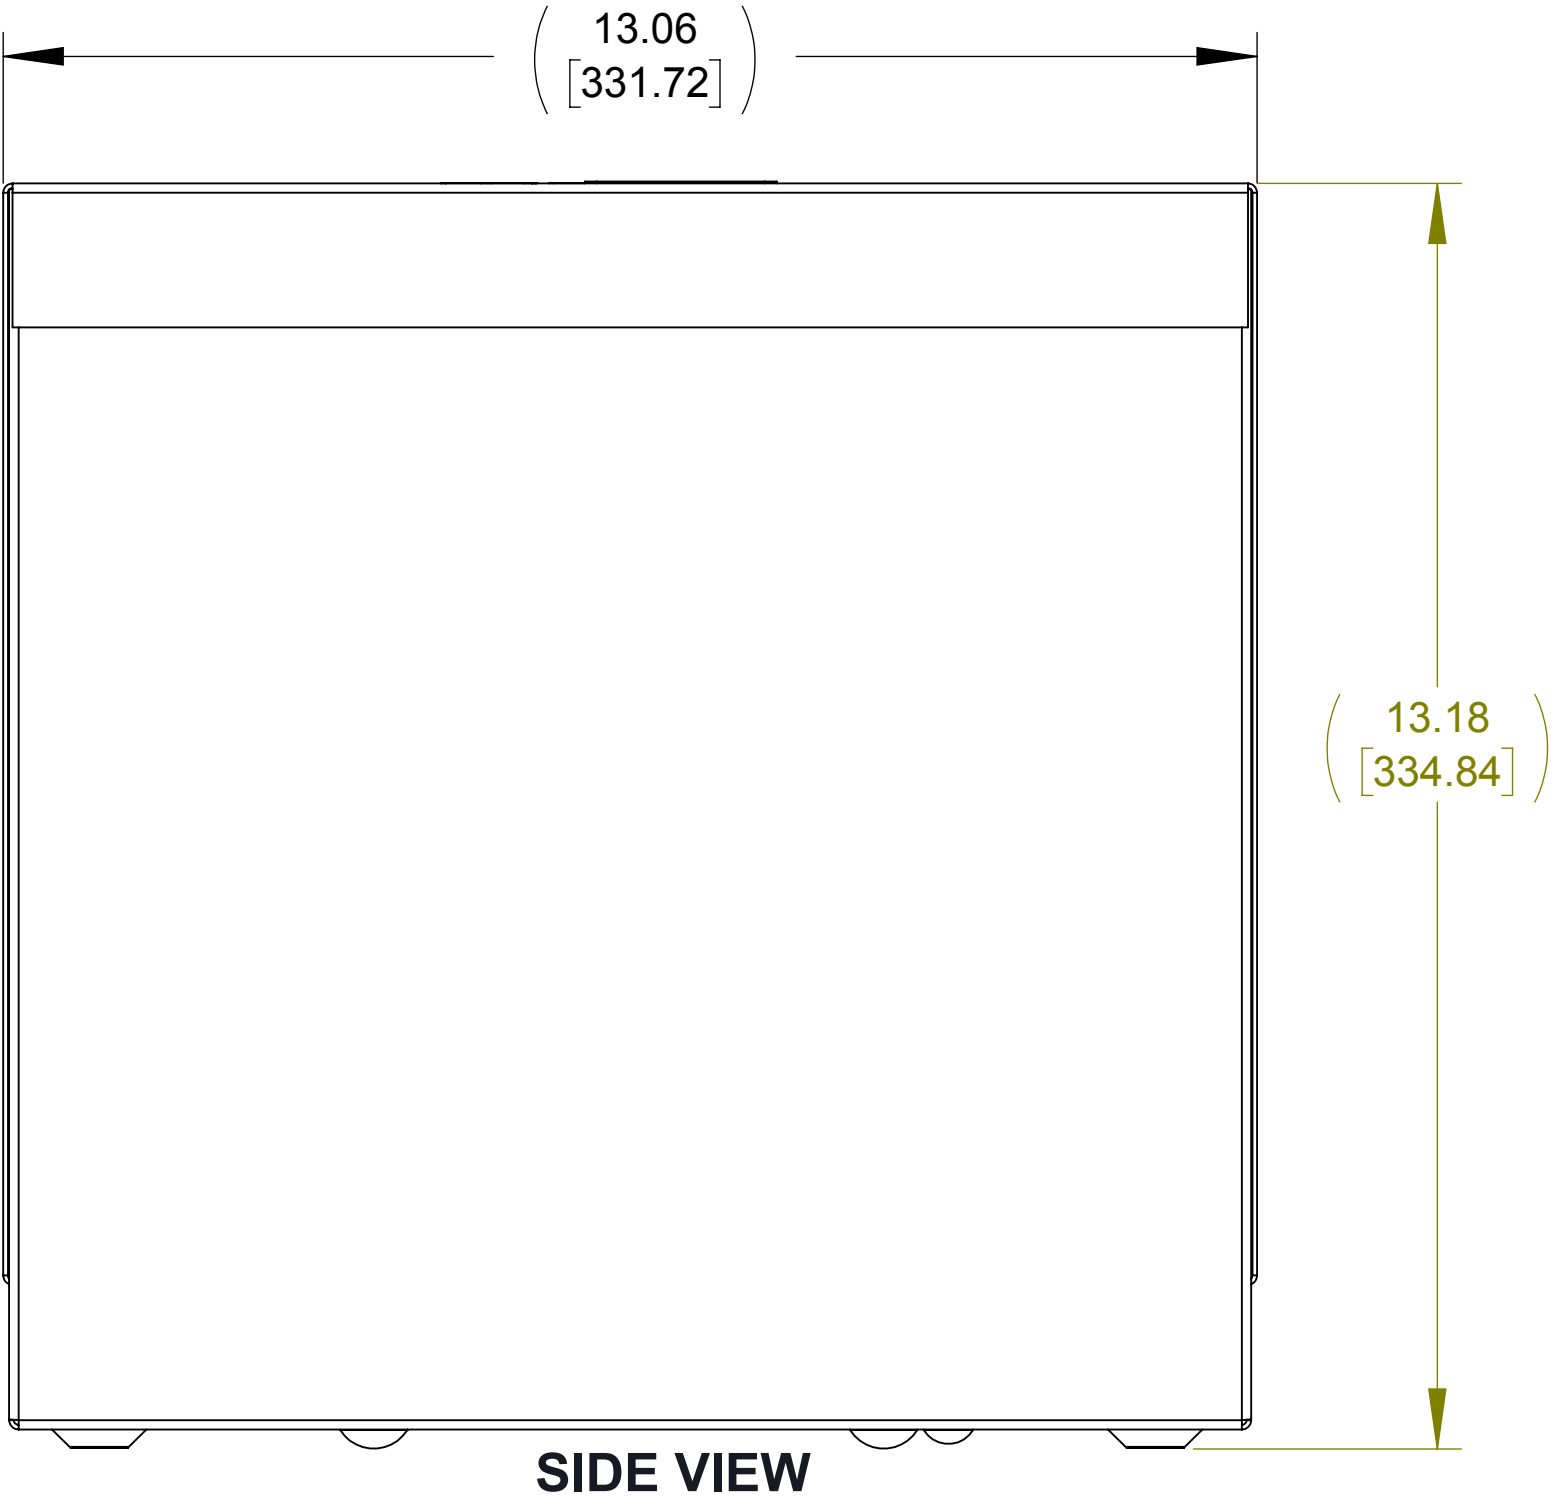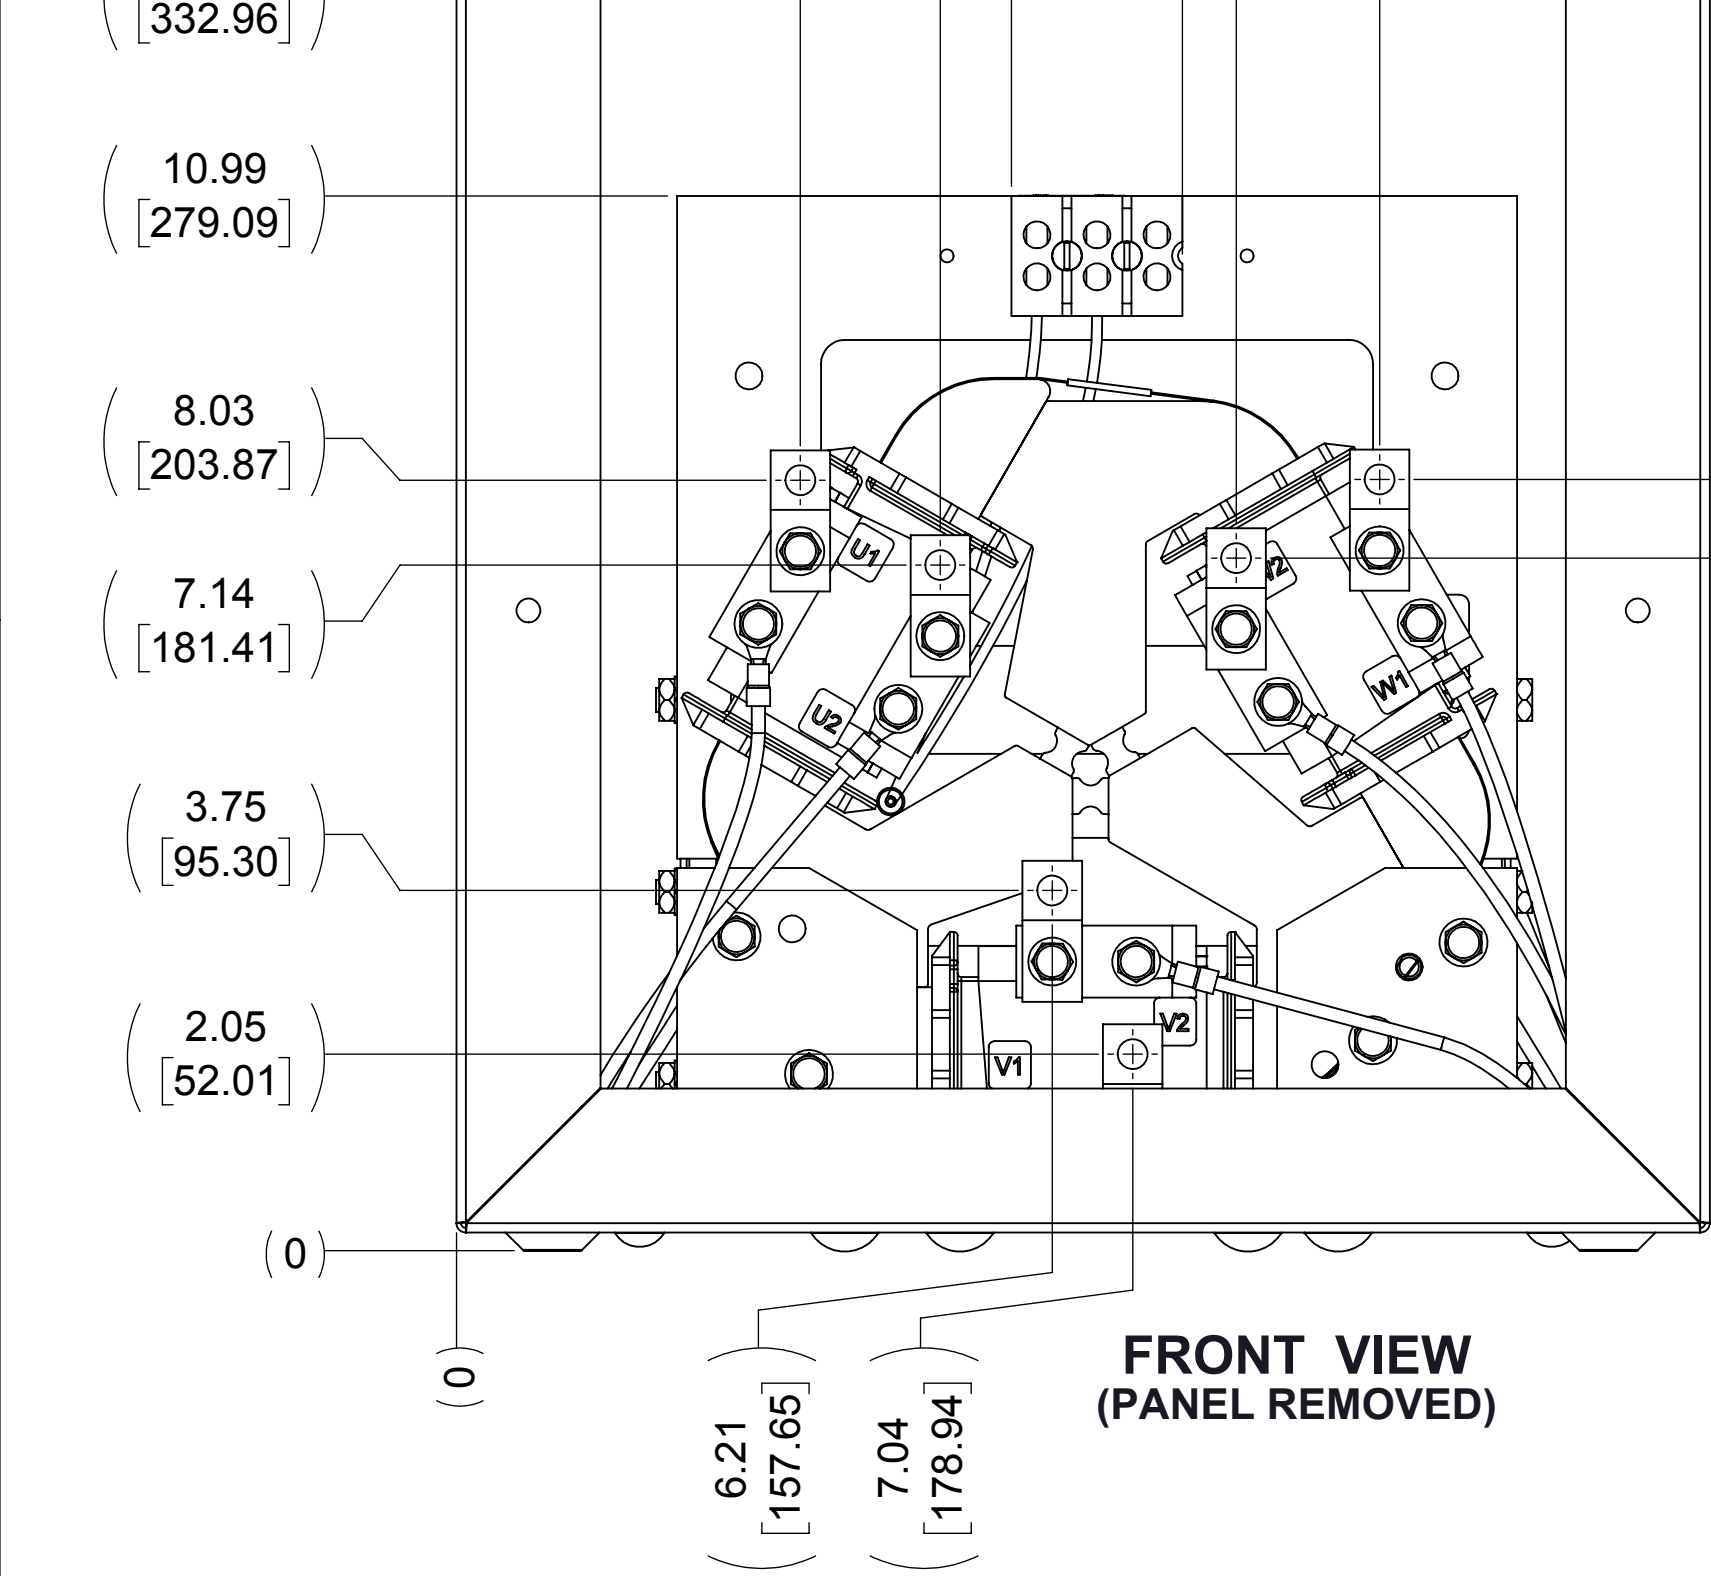

- NOTES:**
1. WIRE RANGE: 4 - 18 AWG.
  2. TERMINAL SCREW TIGHTENING TORQUE: 16 IN/LBS
  3. WIRE RANGE: 1/0 - 14 AWG.
  4. TERMINAL SCREW TIGHTENING TORQUE: (1/0-3AWG) 50 IN/LBS, (4-6AWG) 45 IN/LBS, (8AWG) 40 IN/LBS, (10-14AWG) 35 IN/LBS

THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU(EUROPEAN UNION) DIRECTIVE RoHS2		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION					
CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION				DESCRIPTION					
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES [MM] TOLERANCES ARE:  ANGLES: ± 1 °  1 PLACE .X: ± .1 [2.5]  2 PLACE .XX: ± .03 [0.76]  3 PLACE .XXX: ± .010 [0.254]		  N83 W13330 Leon Road Menomonee Falls, WI 53051 USA 800.455-4683 262.253-8200		DV SENTRY 65A 380-600V FILTER, NEMA 1/2 ENCL.					
DRAWN JT		DATE 06/06/14		SIZE D		DWG No. CD DVSG0065E		REV 02	
CHECKED TM		DATE 01/18/17							
APPROVED TM		DATE 01/18/17		SCALE 1:2		SHEET 1 OF 1			