



WEIGHT (LBS)
20


ECO No	DESCRIPTION	REV BY	DATE
M11976	CORRECTED DISSOCIATED DIMENSIONS	WF	09/18/19

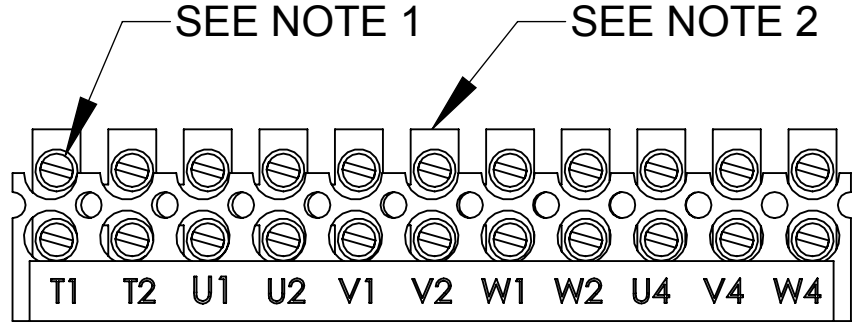



CUSTOMER CONNECTION
DETAIL VIEW
(TOP VIEW OF REACTOR)

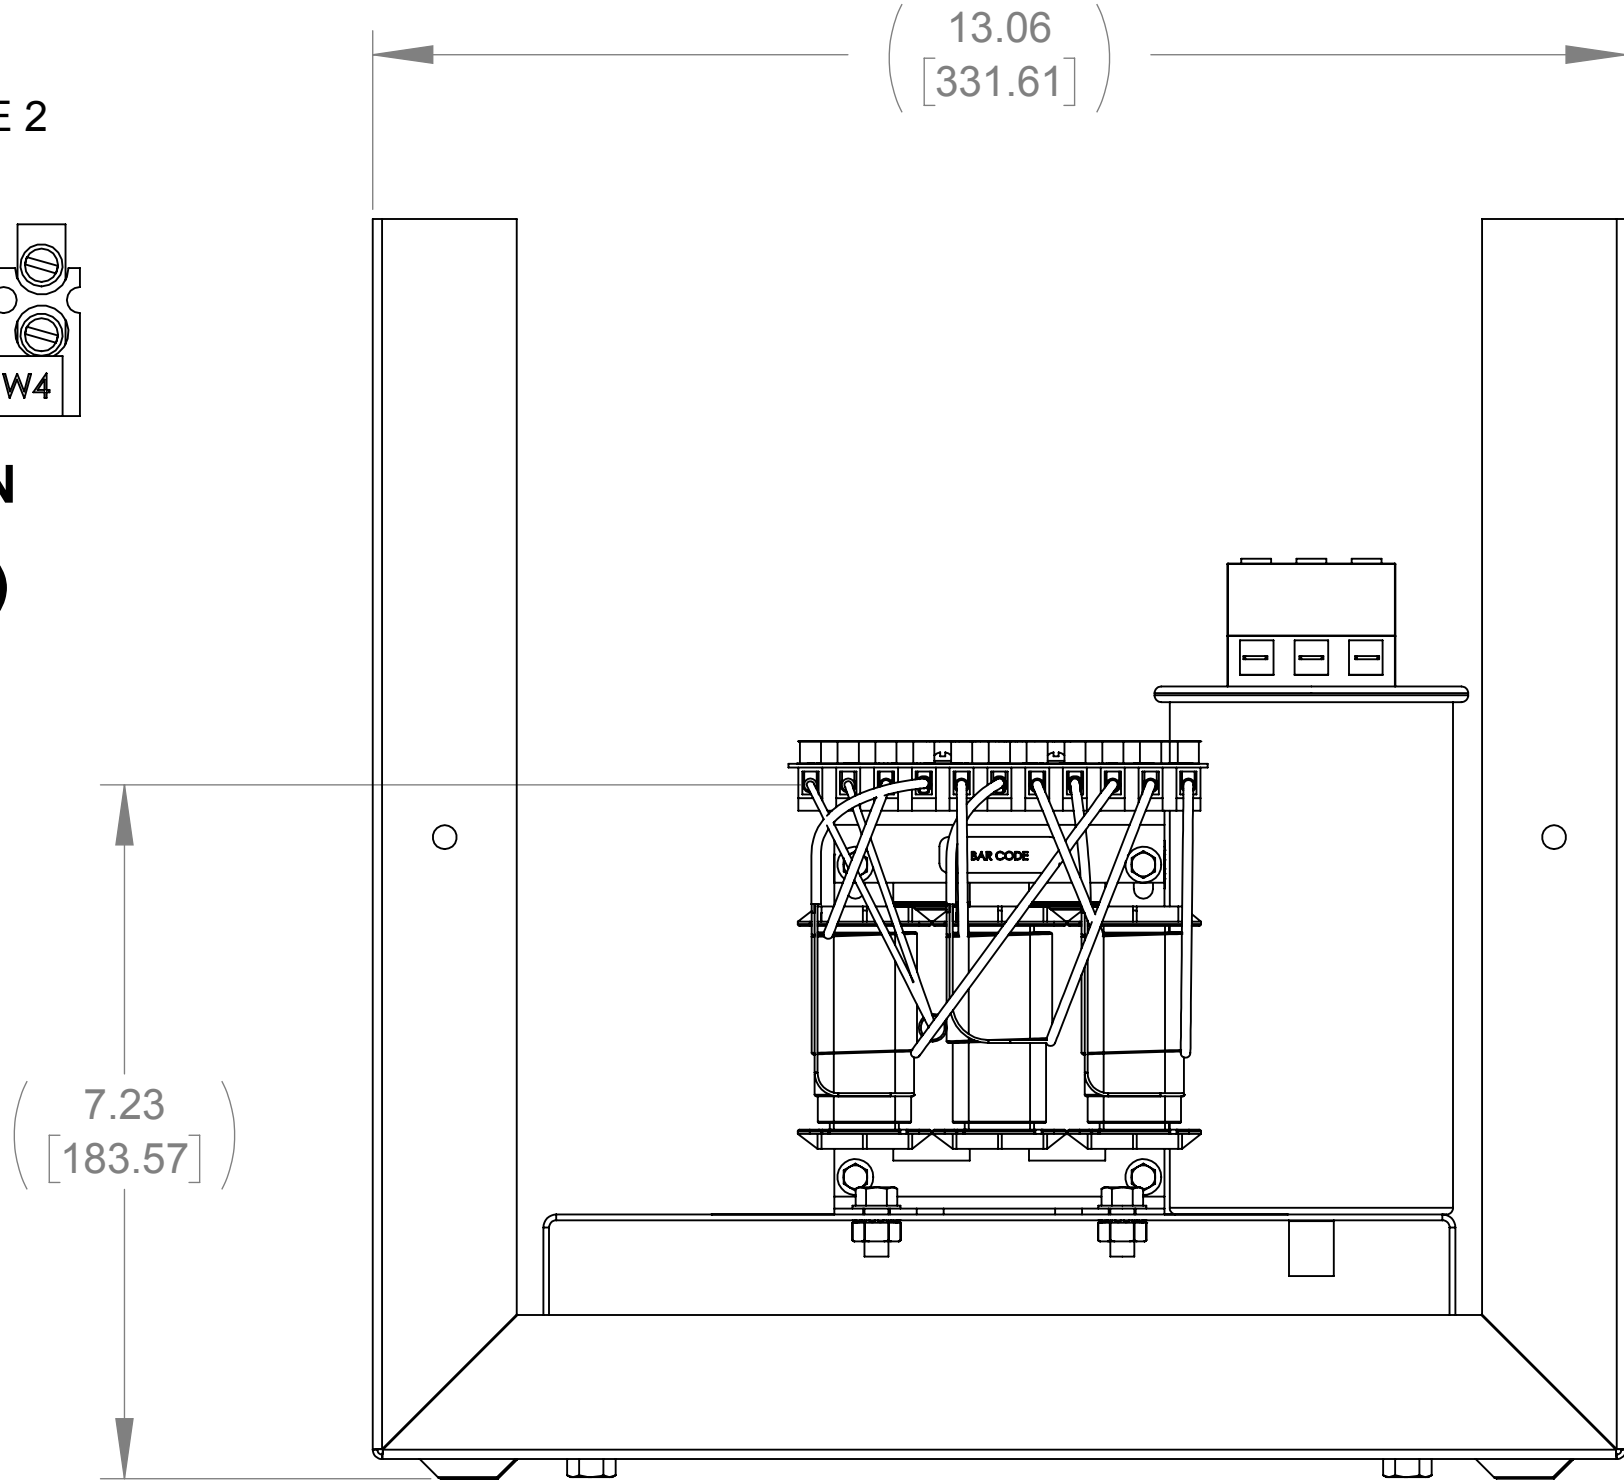


FRONT VIEW
(FRONT PANEL REMOVED)

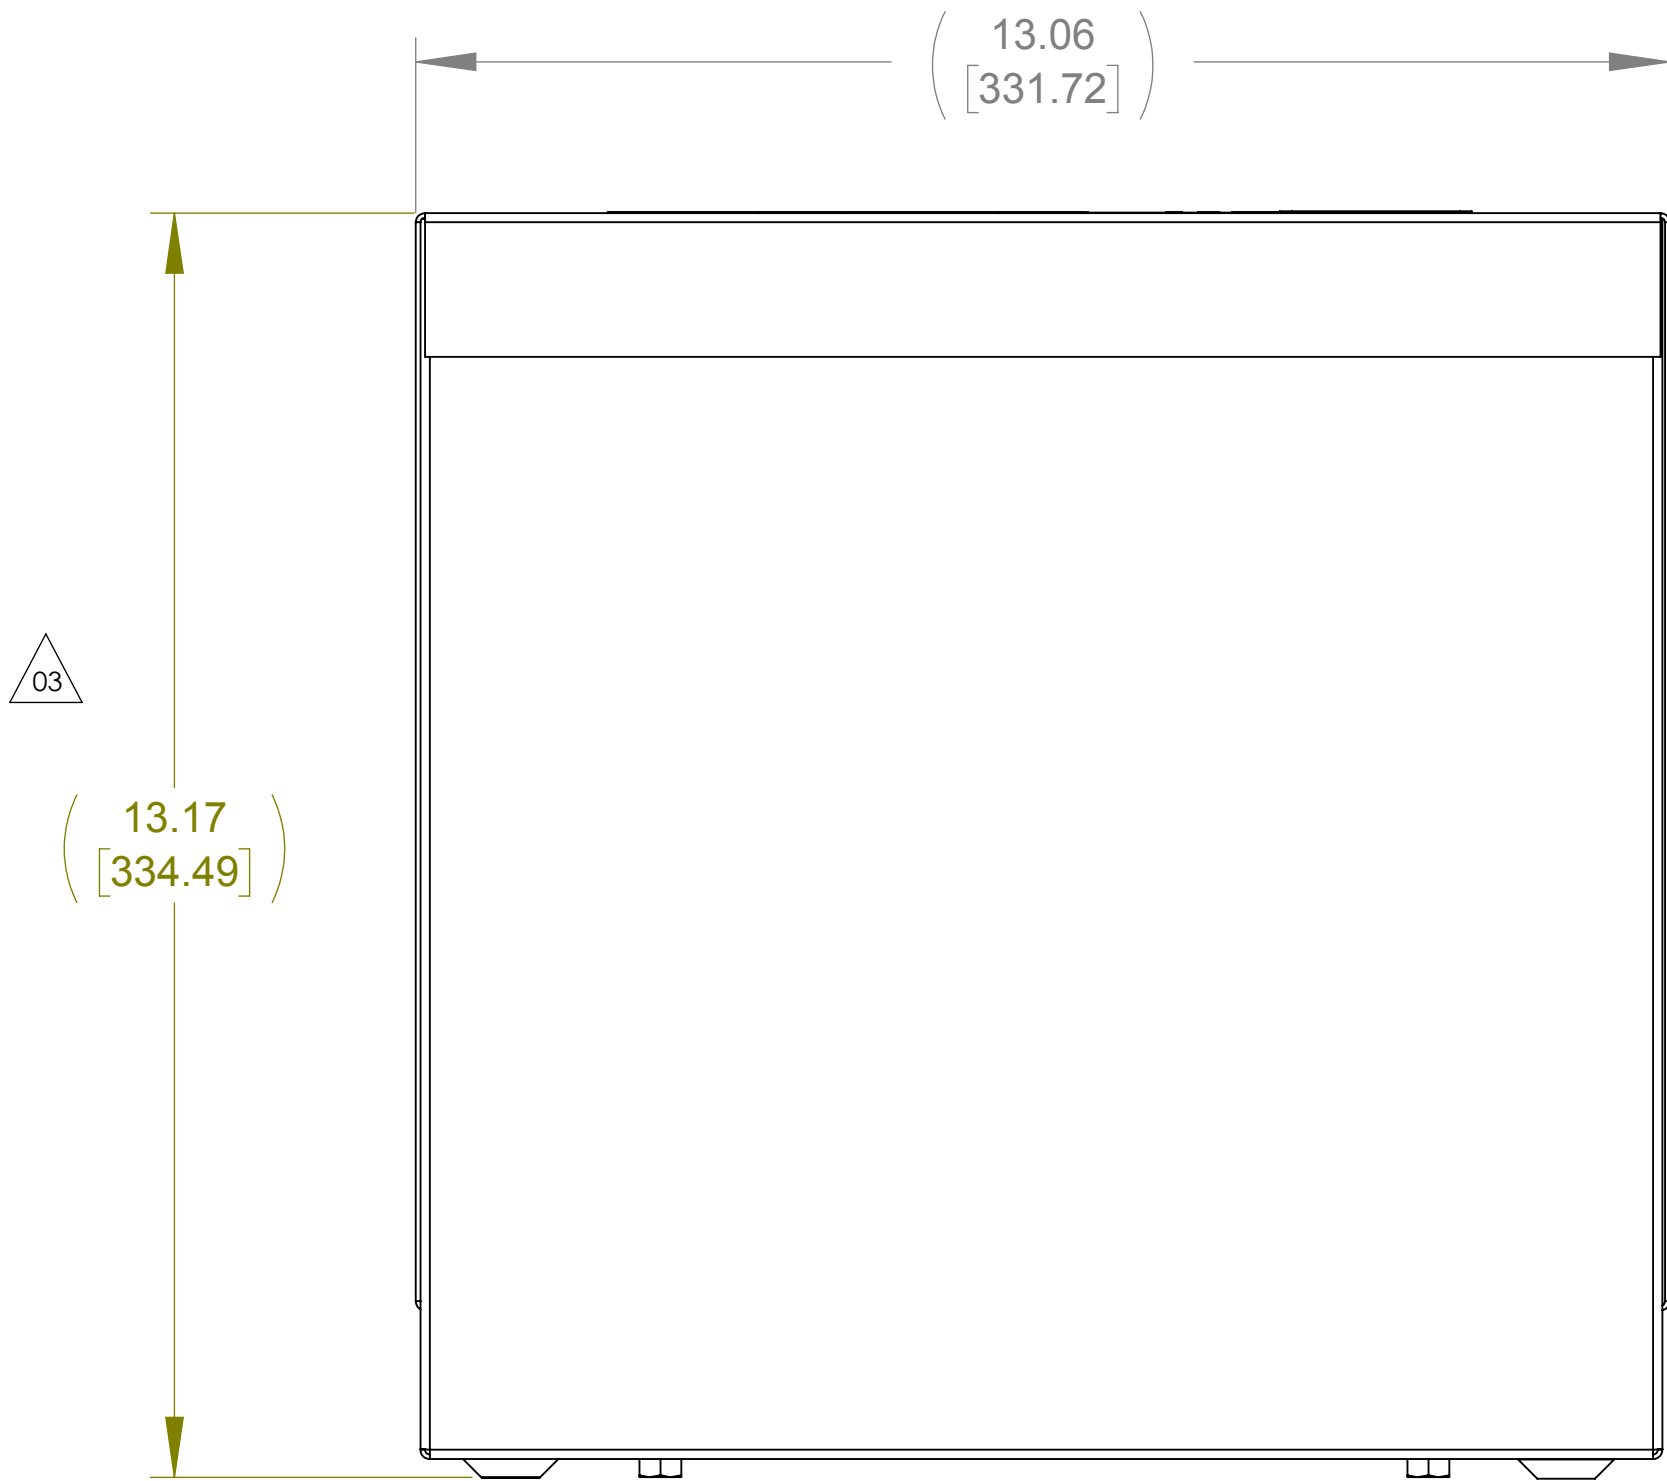


RIGHT SIDE VIEW

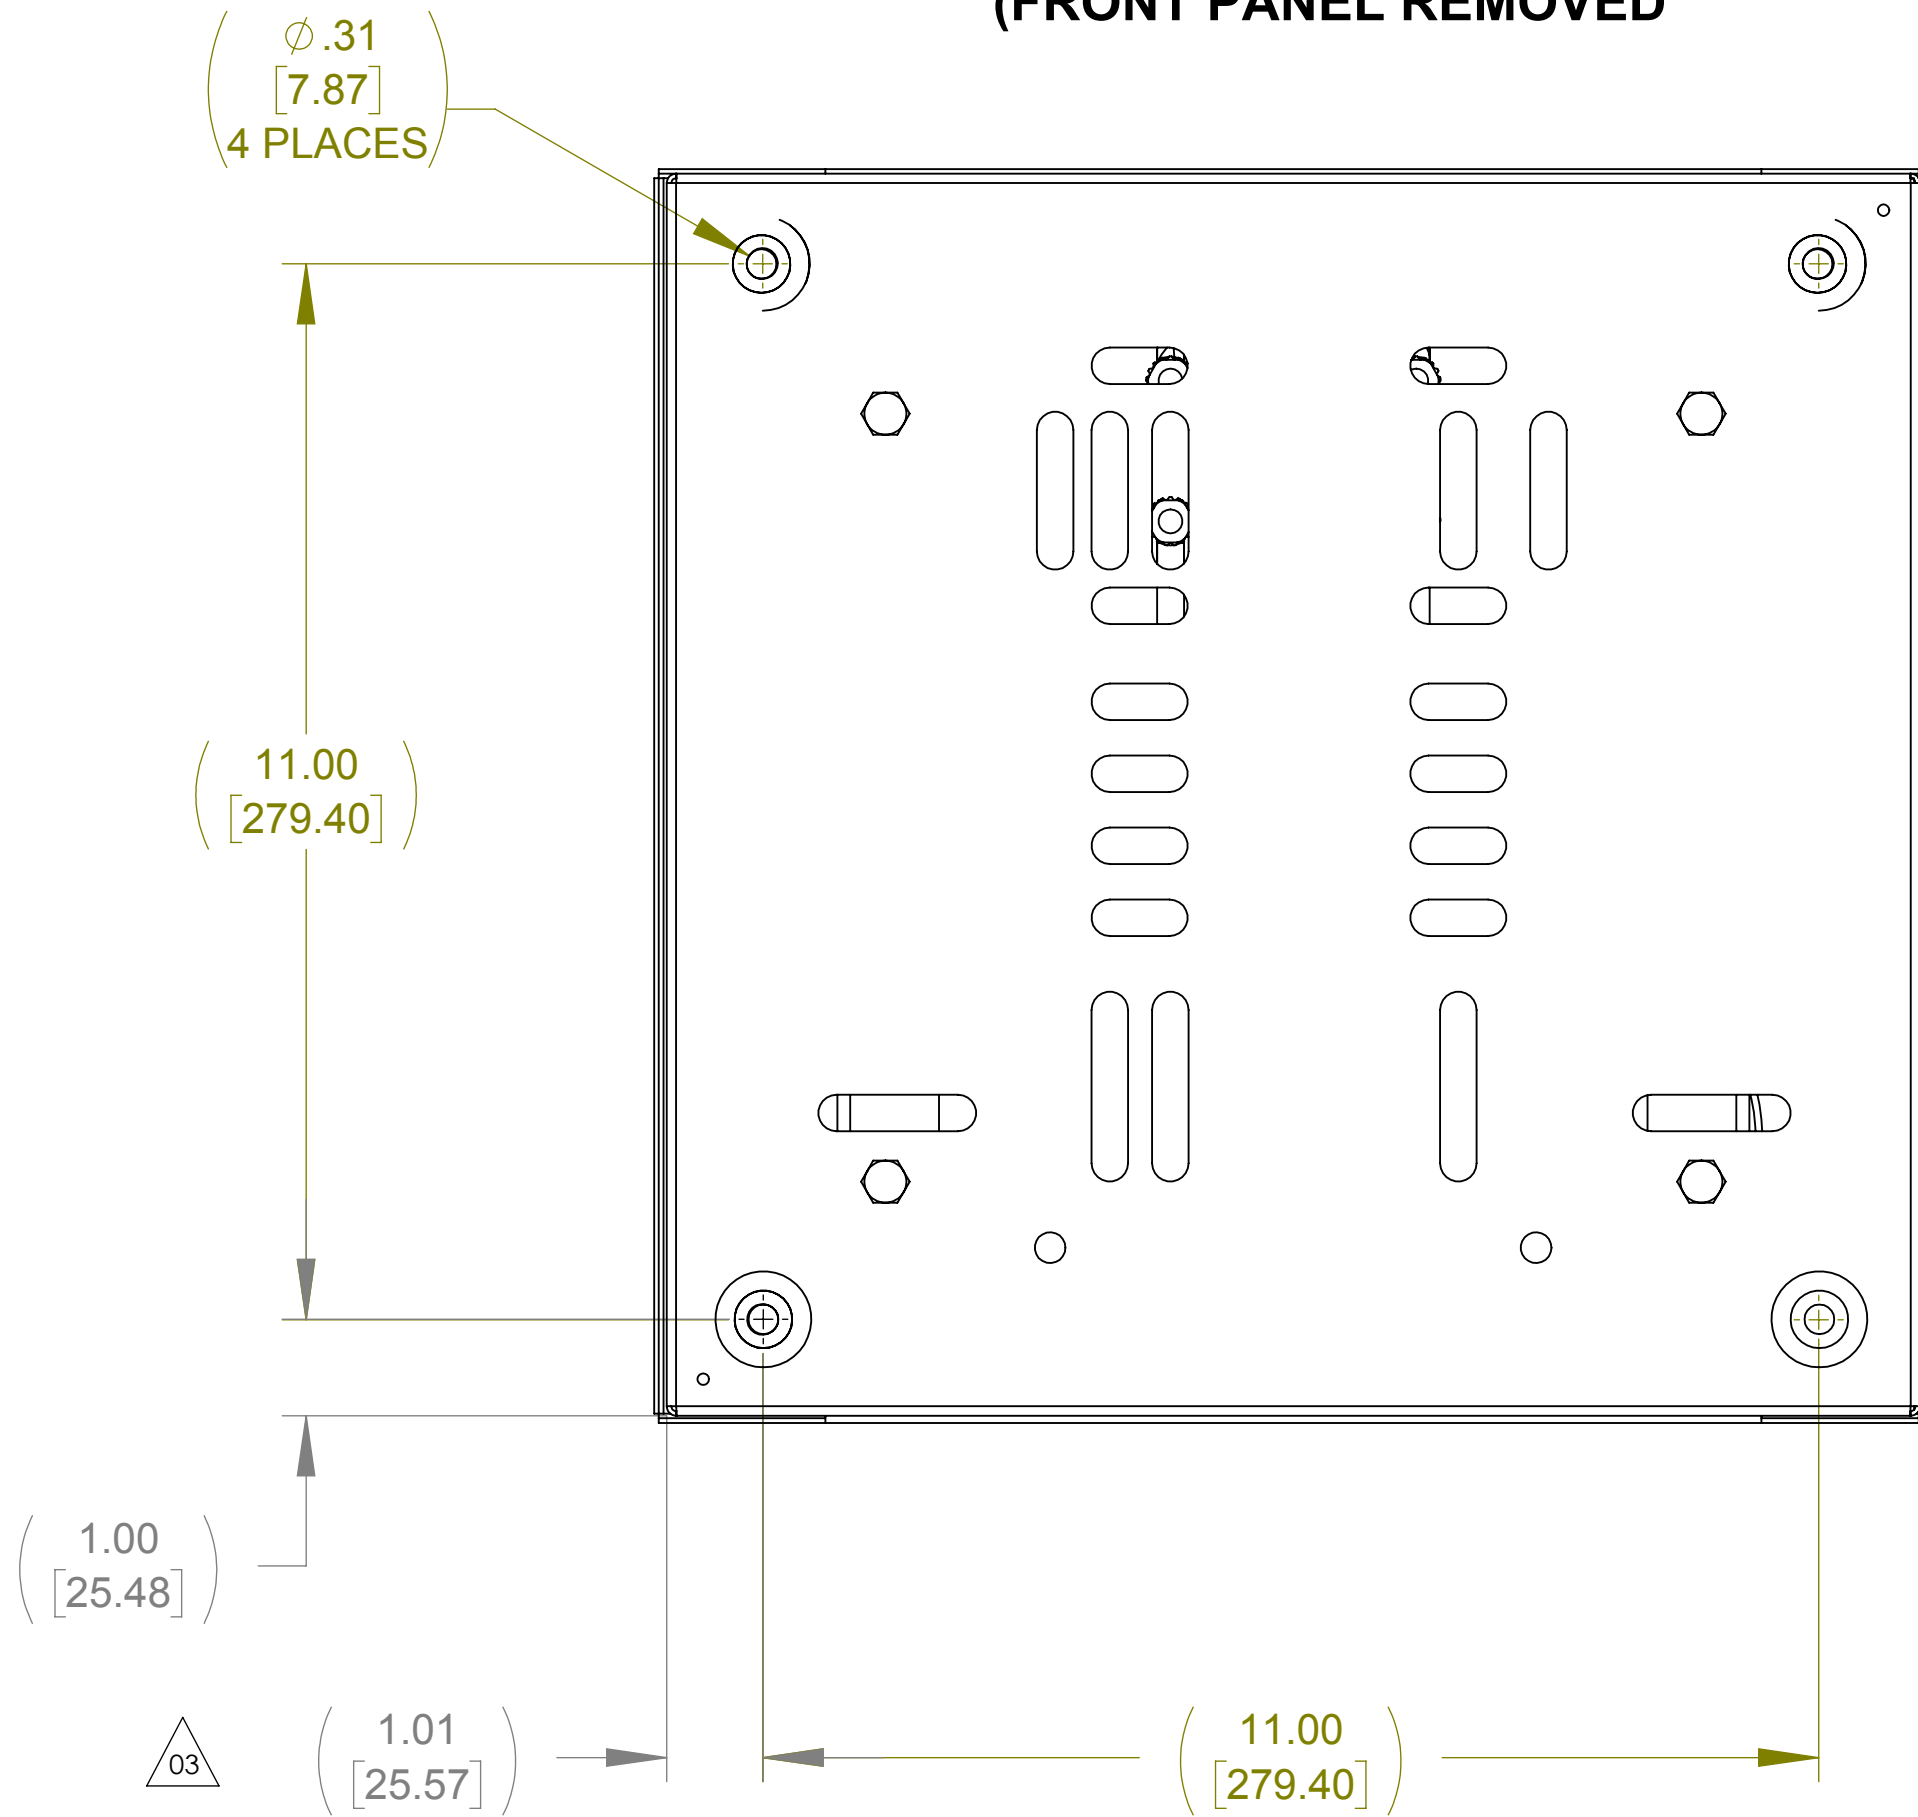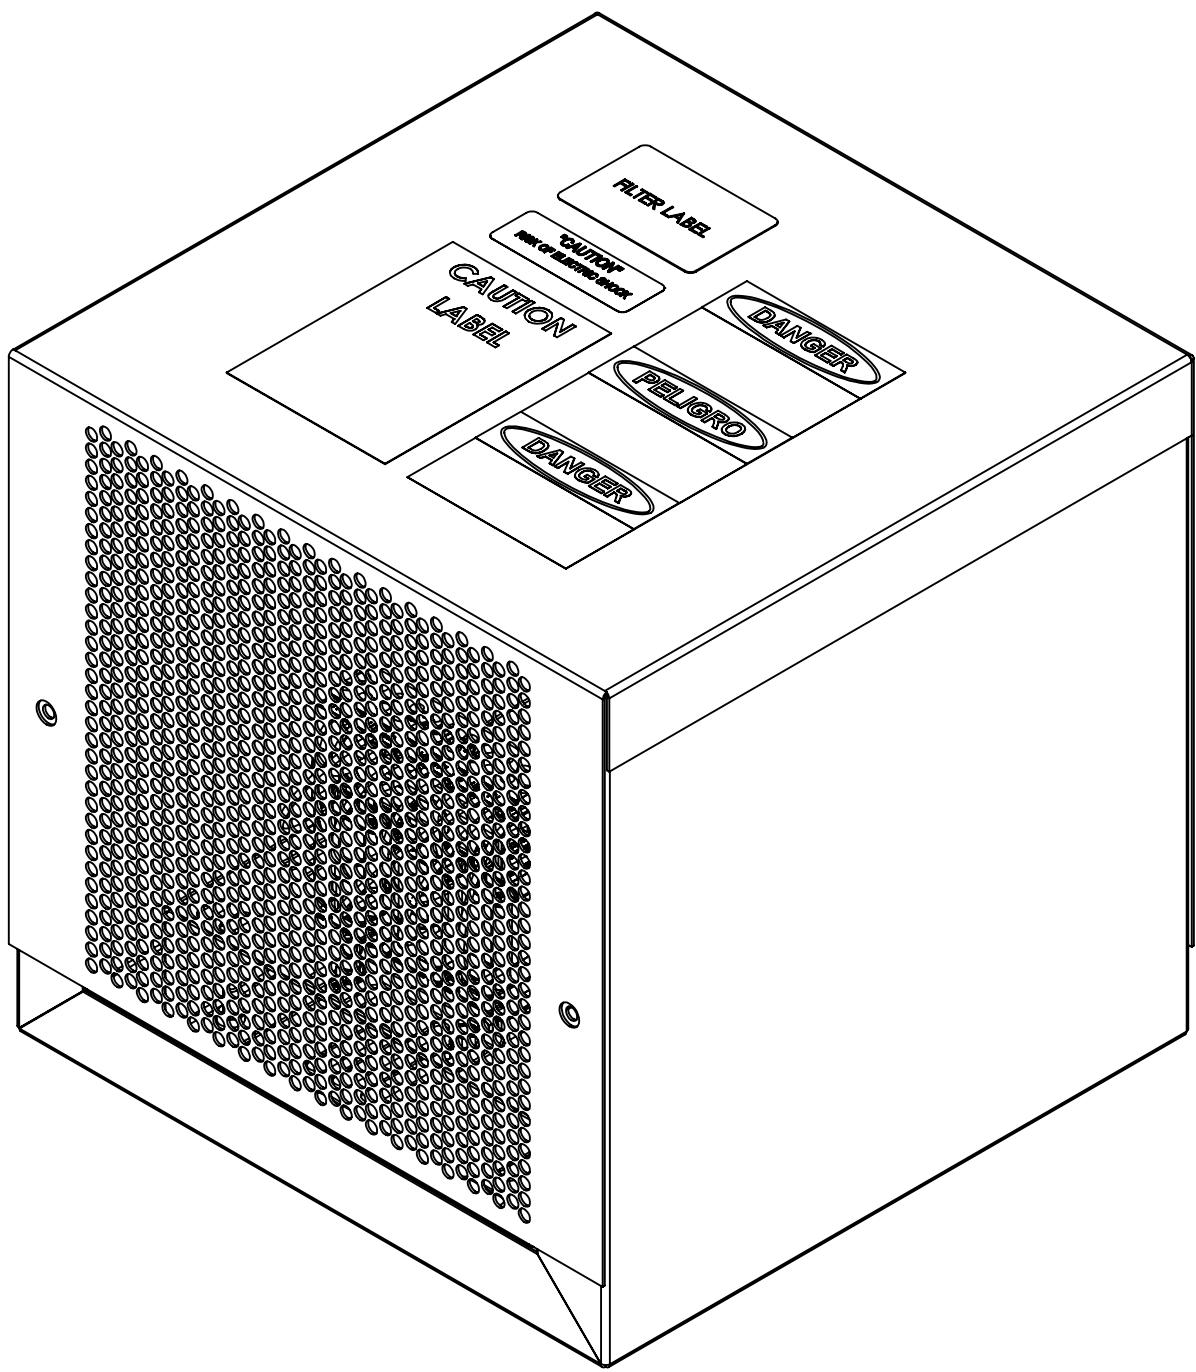

BOTTOM VIEW

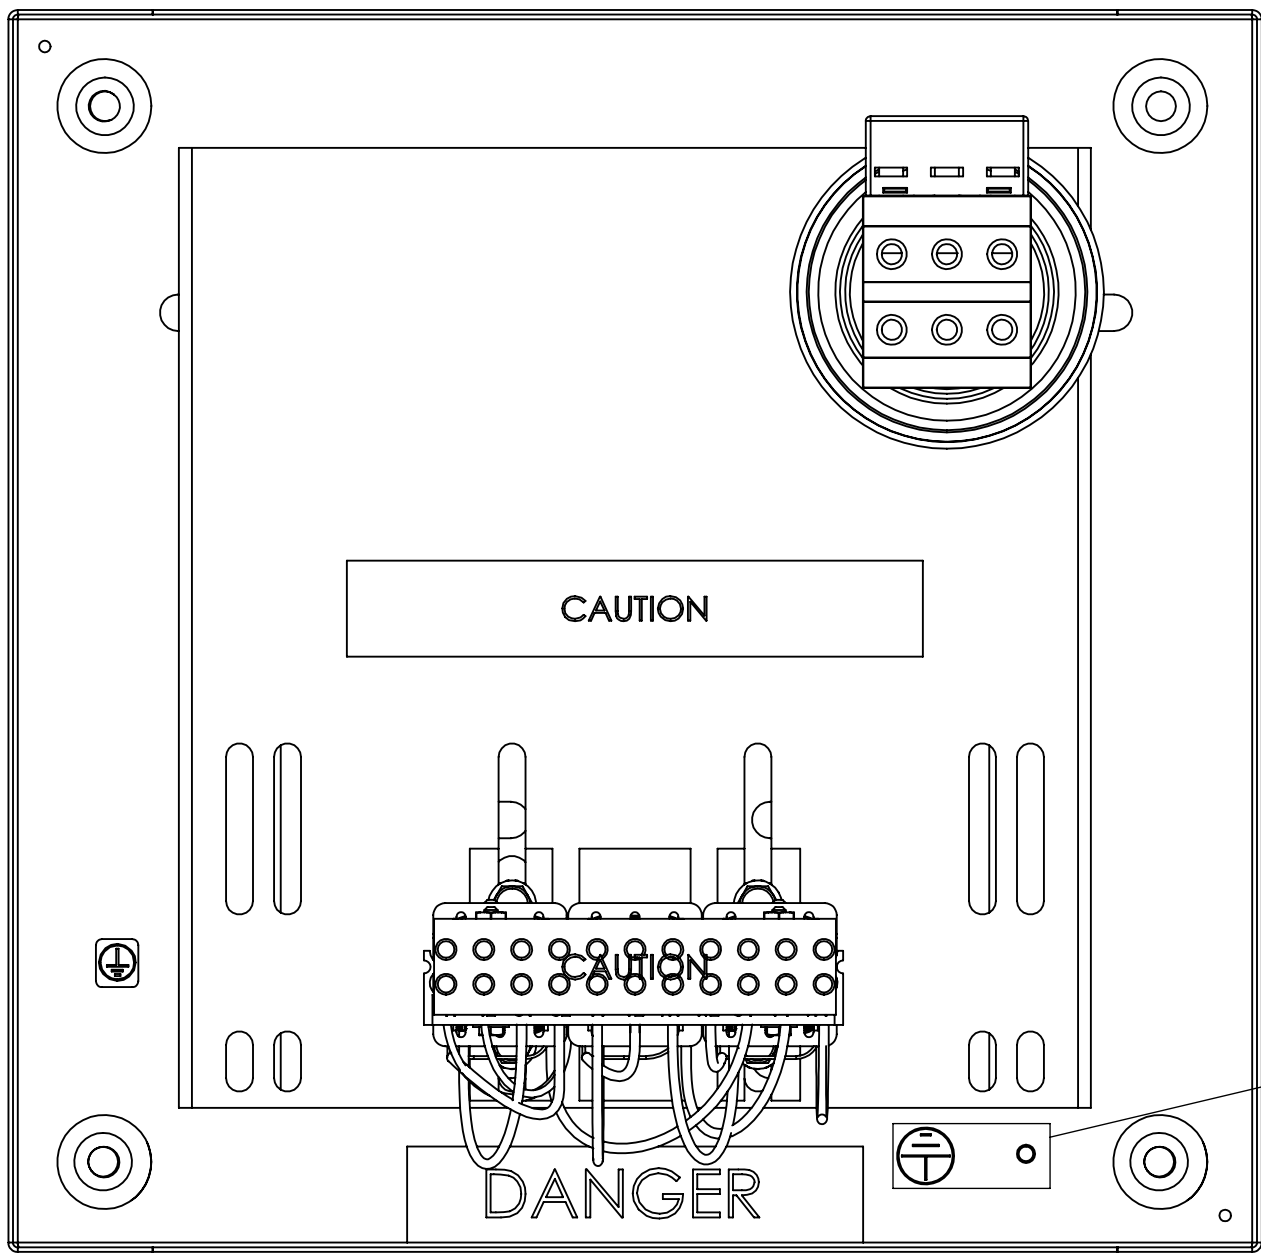

TOP VIEW
(COVER REMOVED)

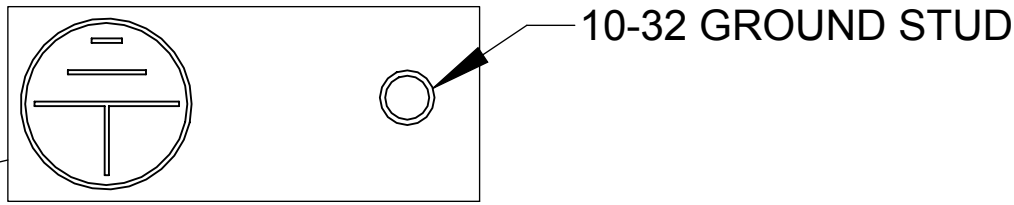

- NOTES:
1. TIGHTEN TERMINAL BLOCK SCREWS TO 16 IN/LBS. TORQUE, MAX.
 2. TERMINAL WIRE SIZE: 4-14 AWG

THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU(EUROPEAN UNION) DIRECTIVE RoHS2		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION		
CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION				DESCRIPTION		
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES [MM] TOLERANCES ARE: ANGLES: ± 1 ° 1 PLACE .X: ± .1 [2.5] 2 PLACE .XX: ± .03 [0.76] 3 PLACE .XXX: ± .010 [0.254]		DRAWN MN		DATE 09/20/13		
		CHECKED WF		DATE 09/18/19		
		APPROVED AK		DATE 09/18/19		
				SIZE D		
				DWG No. CD SWGG0002D		
				REV 03		
				SCALE 1:2		
				SHEET 1 OF 1		

MTE
POWER QUALITY. SOLVED.

N83 W13330 Leon Road
Menomonee Falls, WI 53051 USA
800.455-4683
262.253.8200