

APPROX. WEIGHT (LBS)
1983

ECO No	DESCRIPTION	REV BY	DATE
M9733	REPLACED NG CAPACITOR WITH CDE	KV	12/08/15

D

C

B





A

D



C

B



A

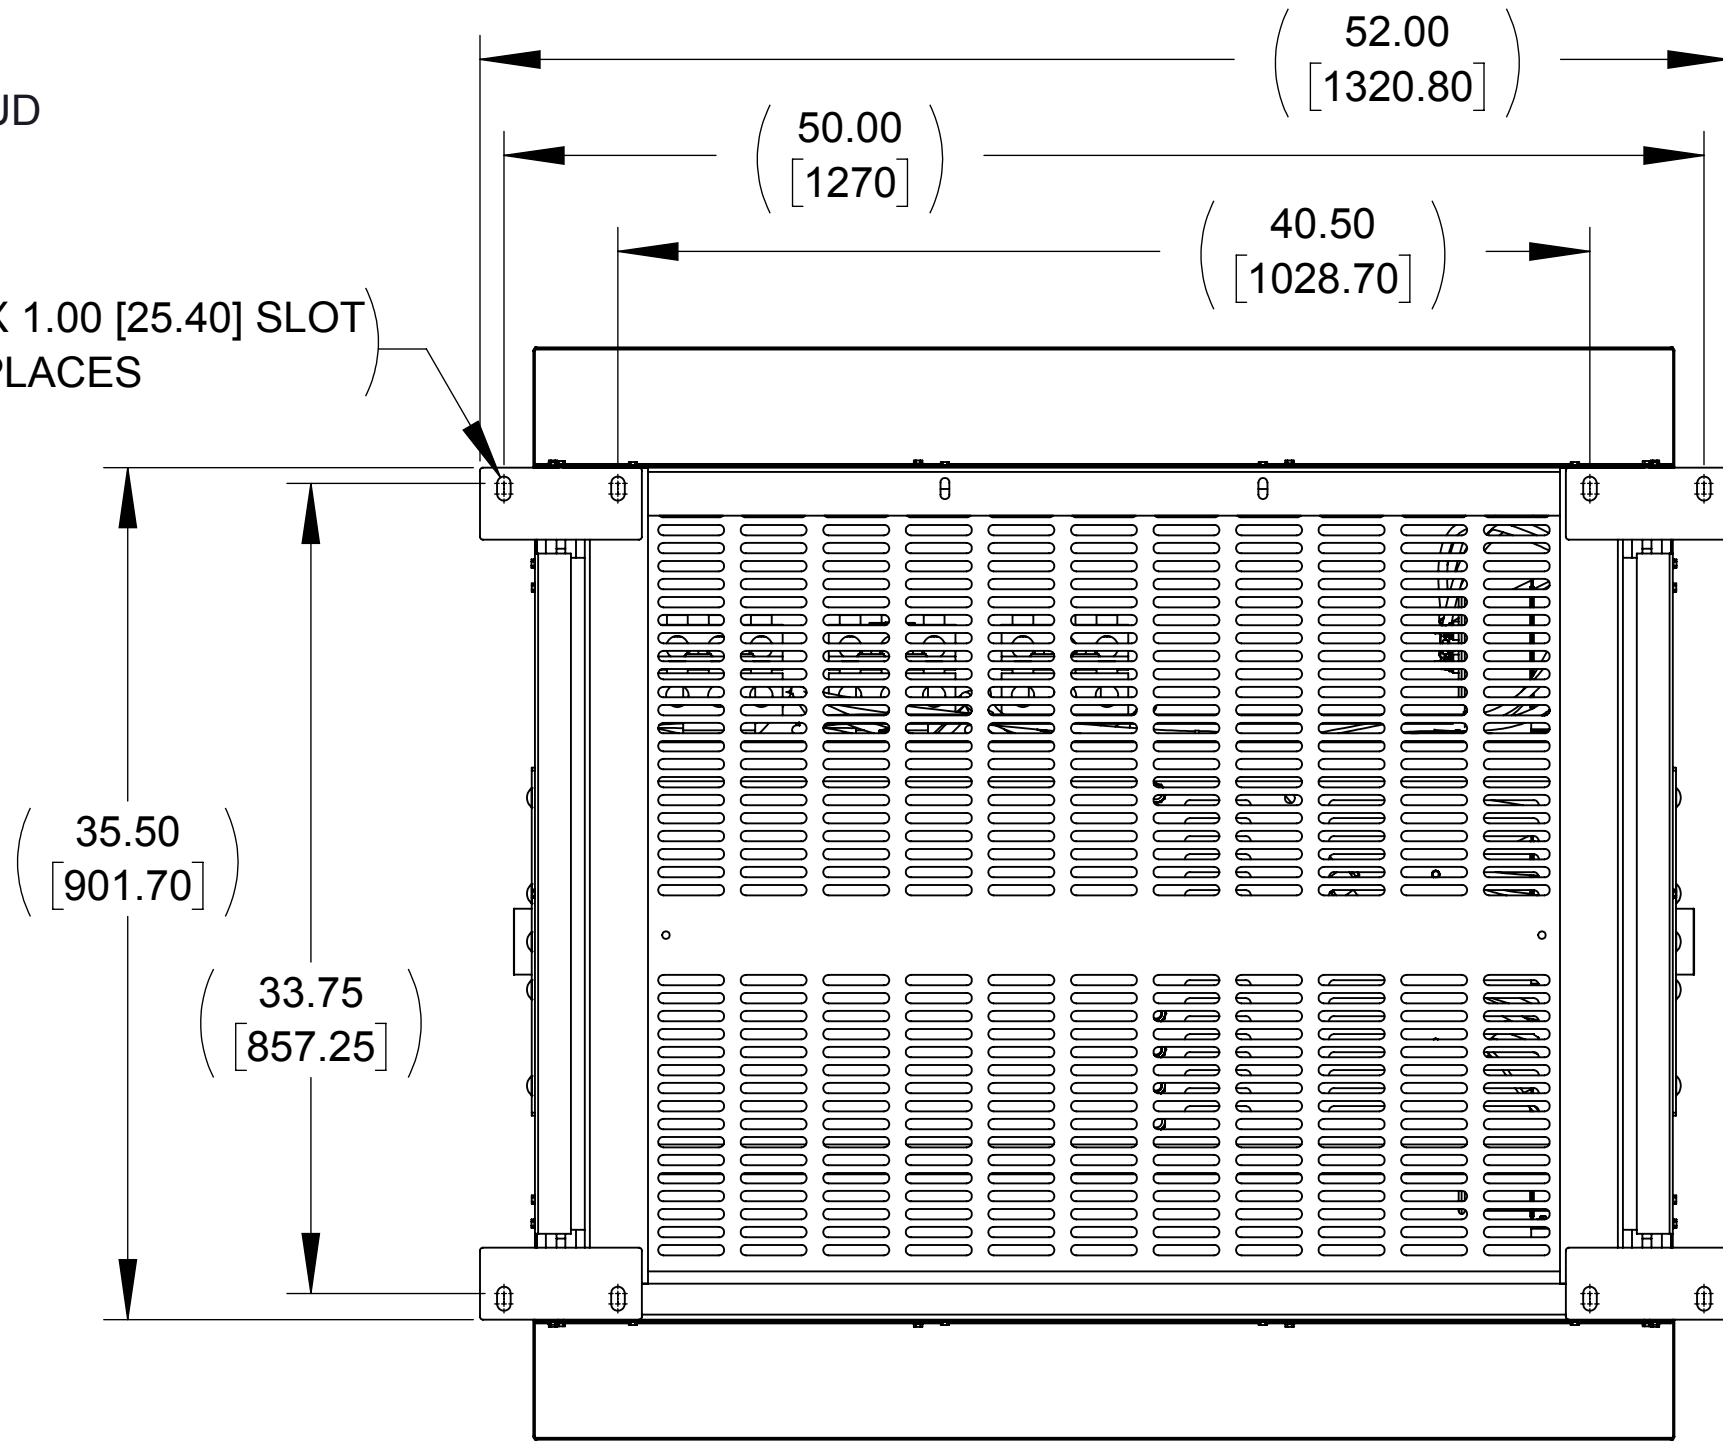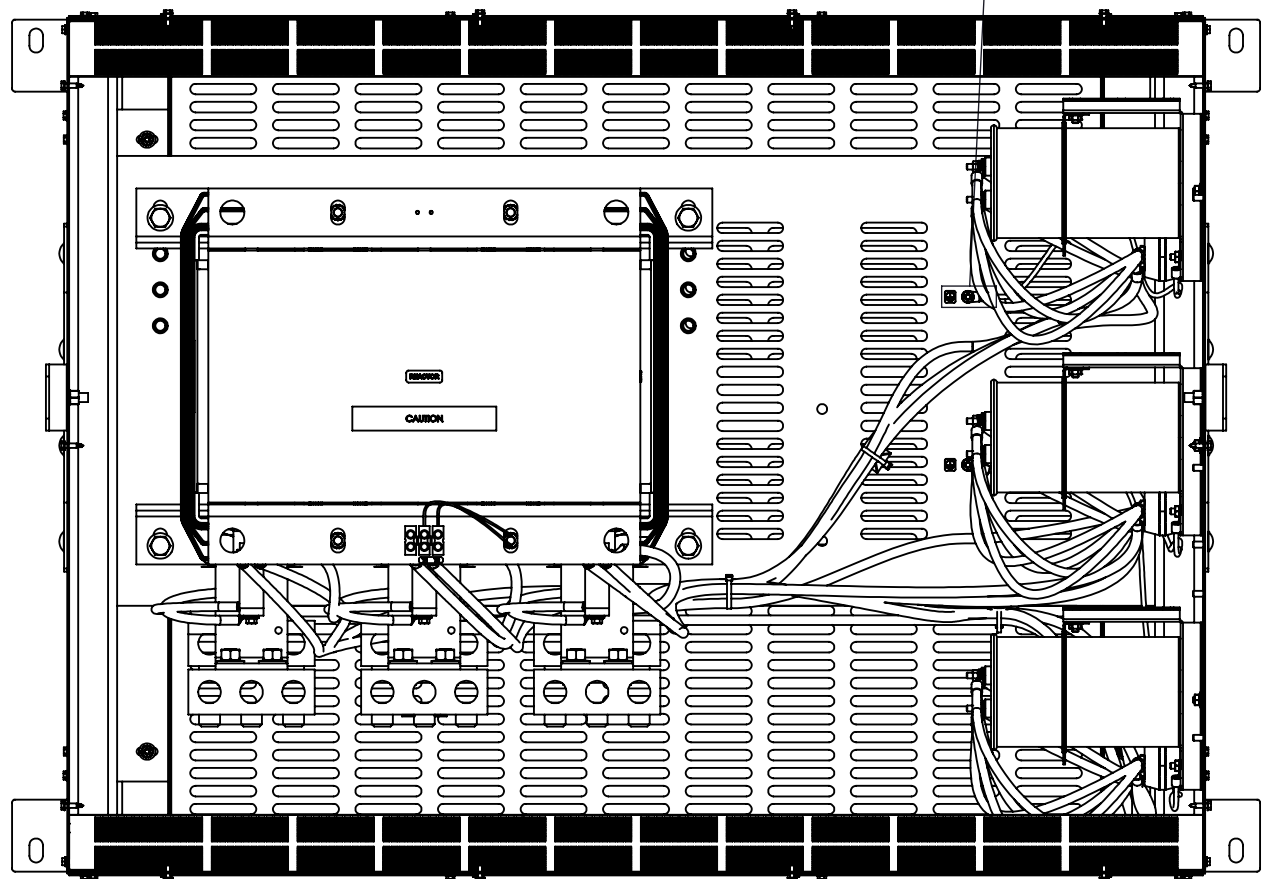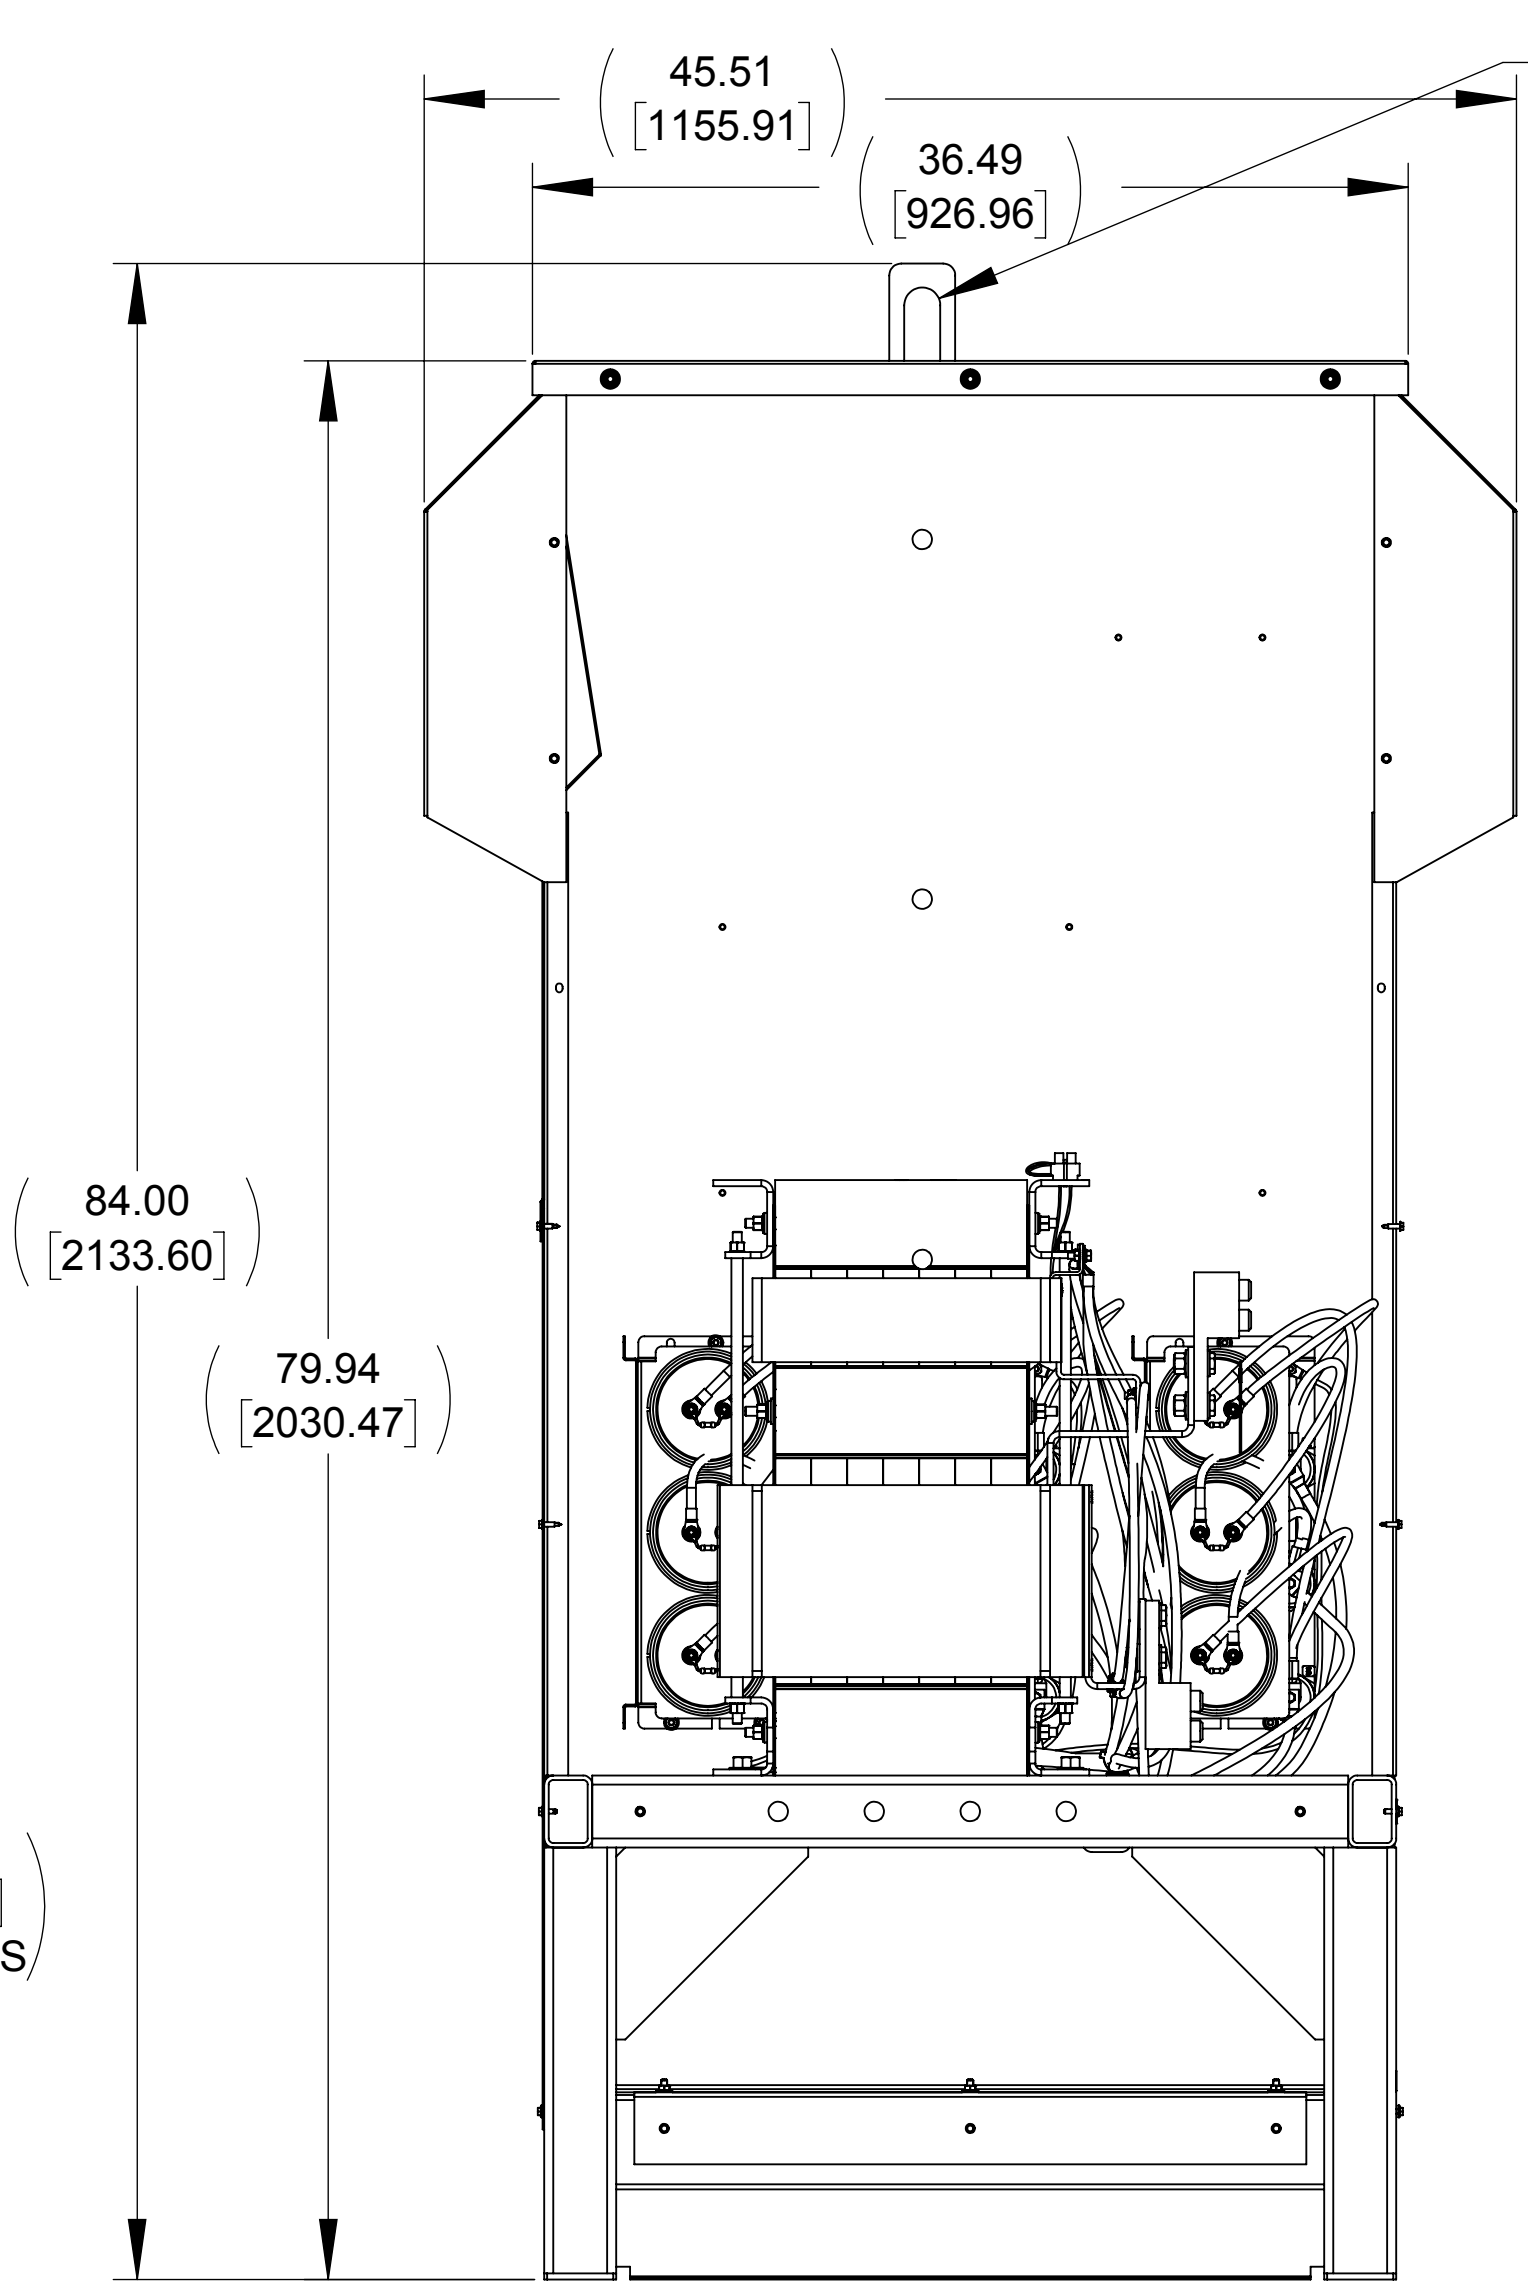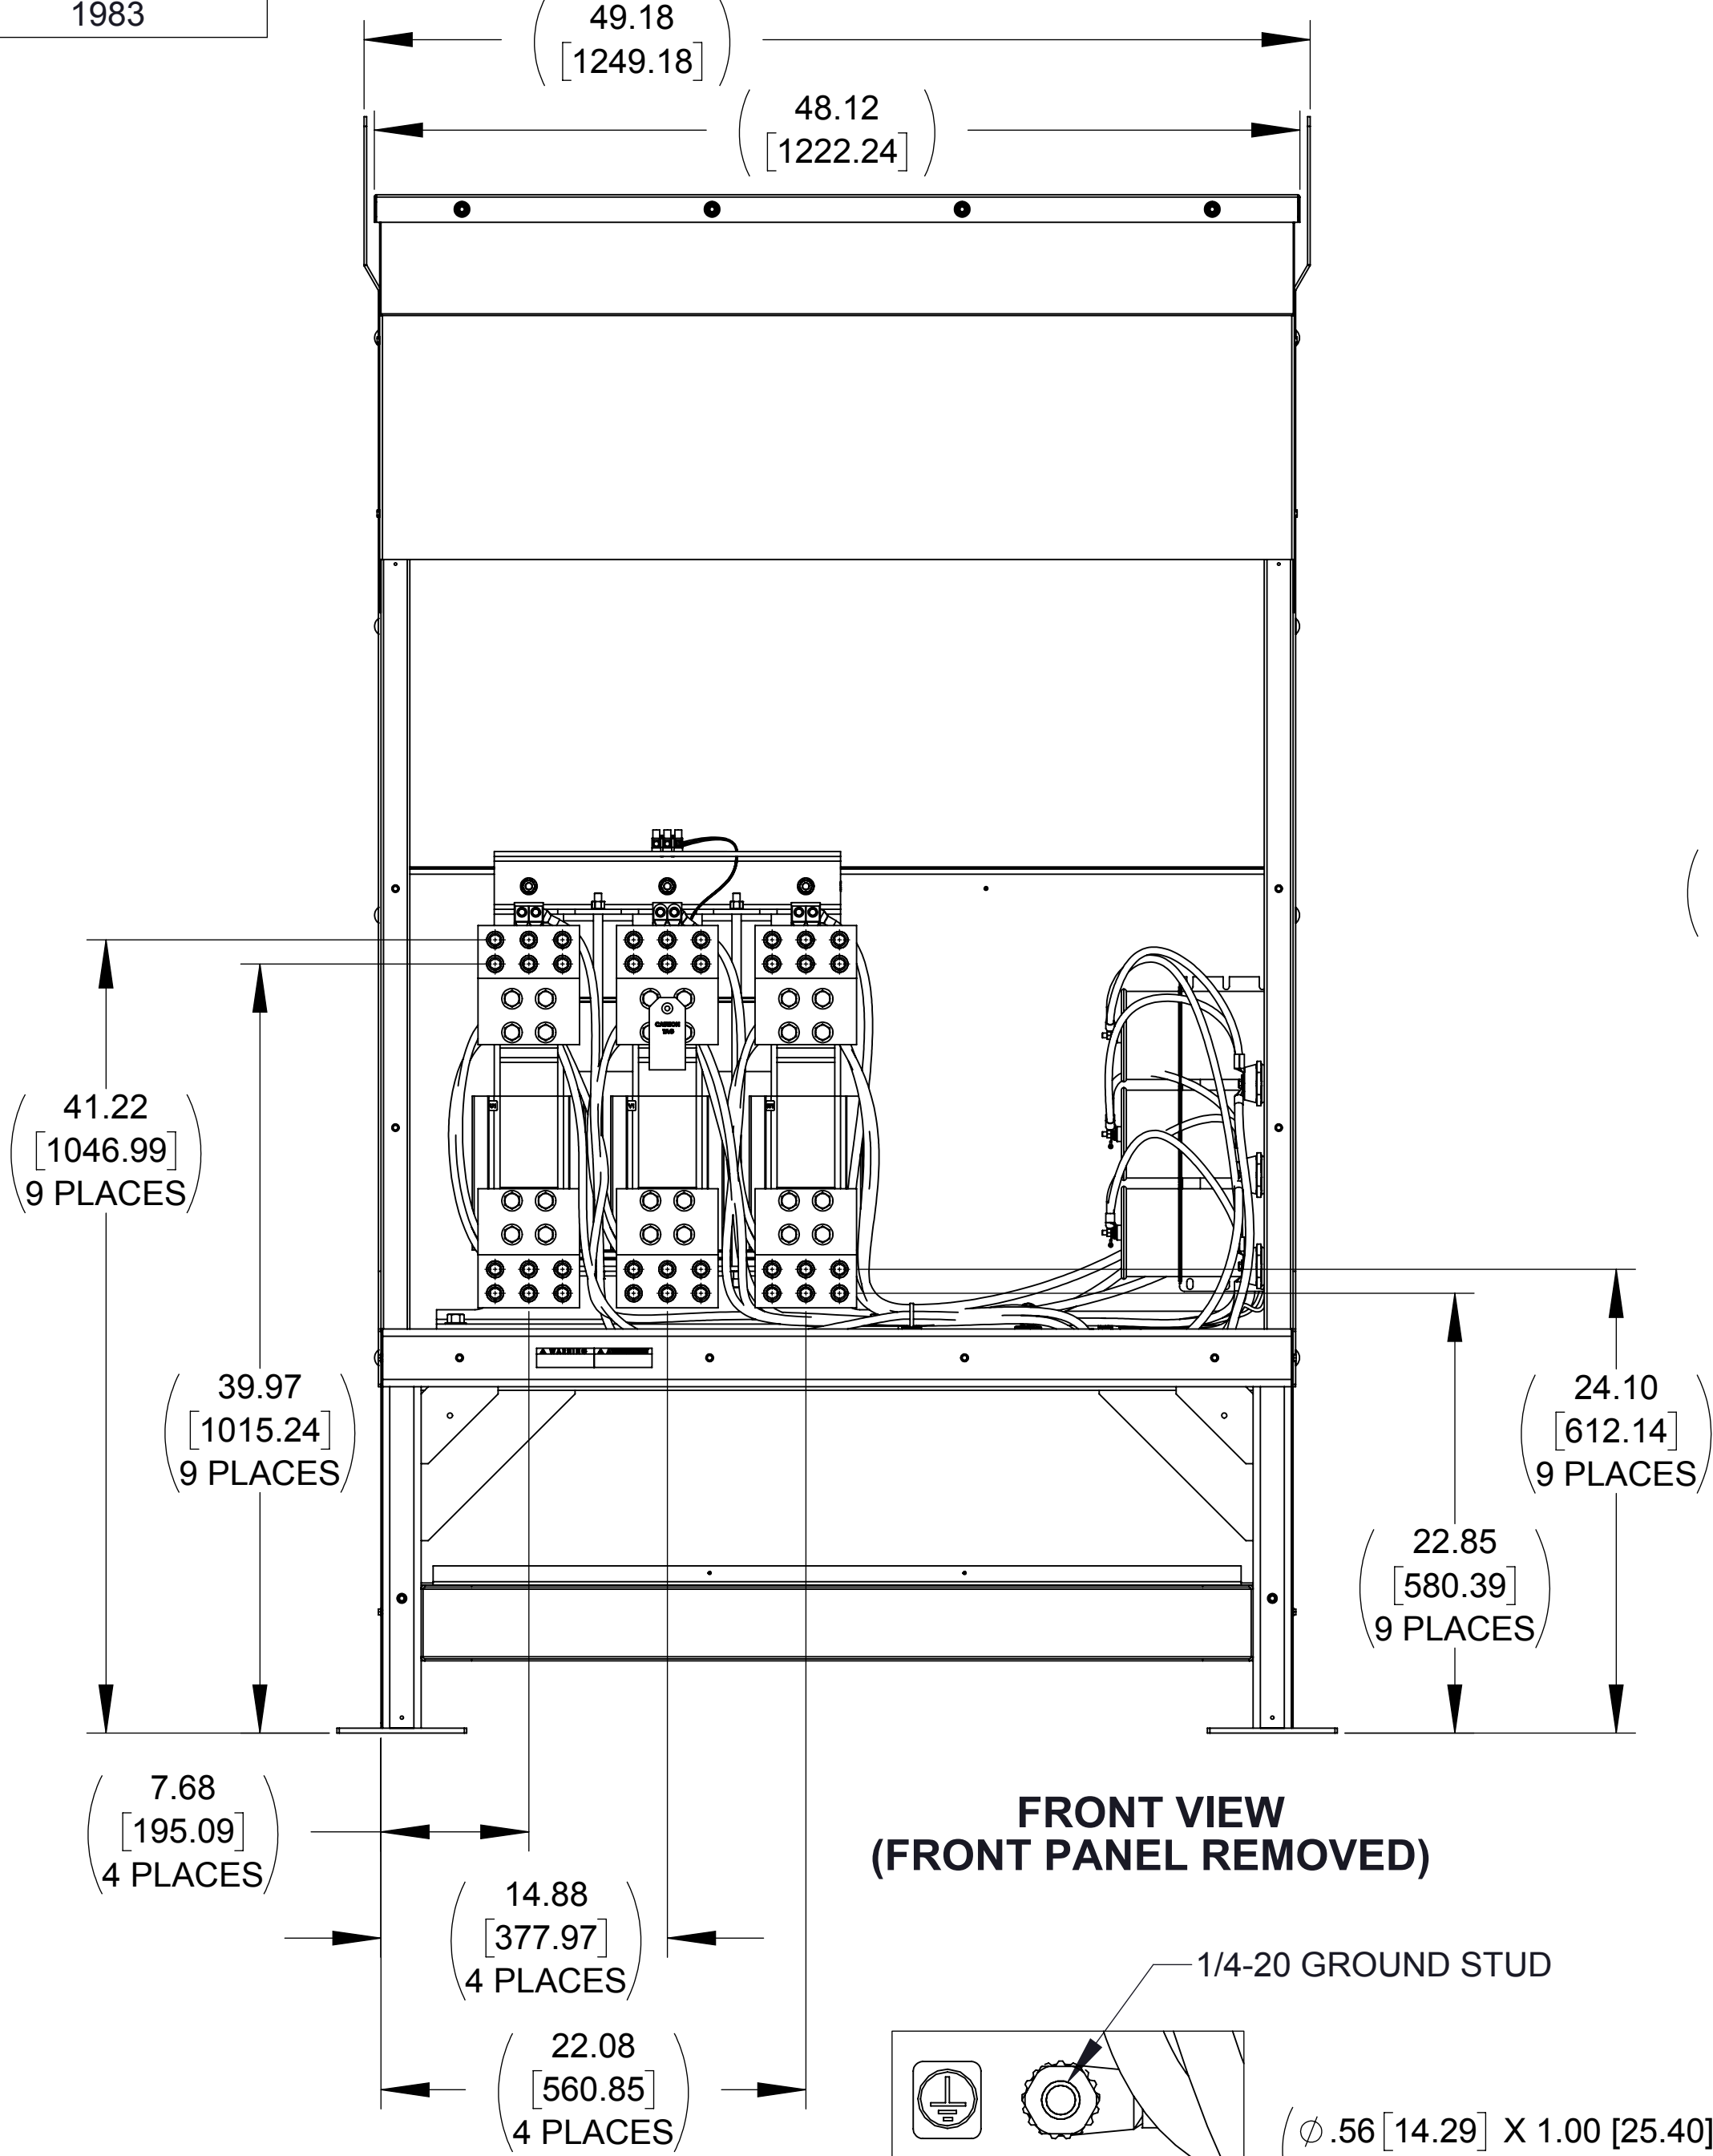

$\varnothing 1.50 [38.10] \times 6.50 [165.10]$ SLOT
2 PLACES

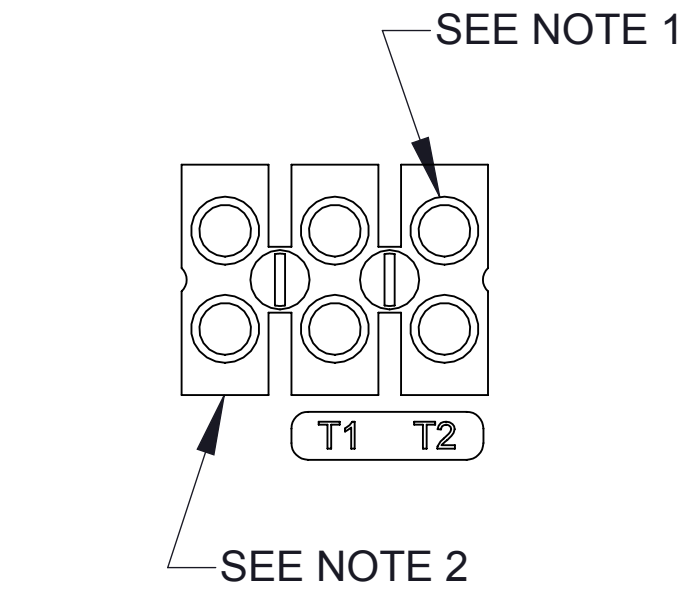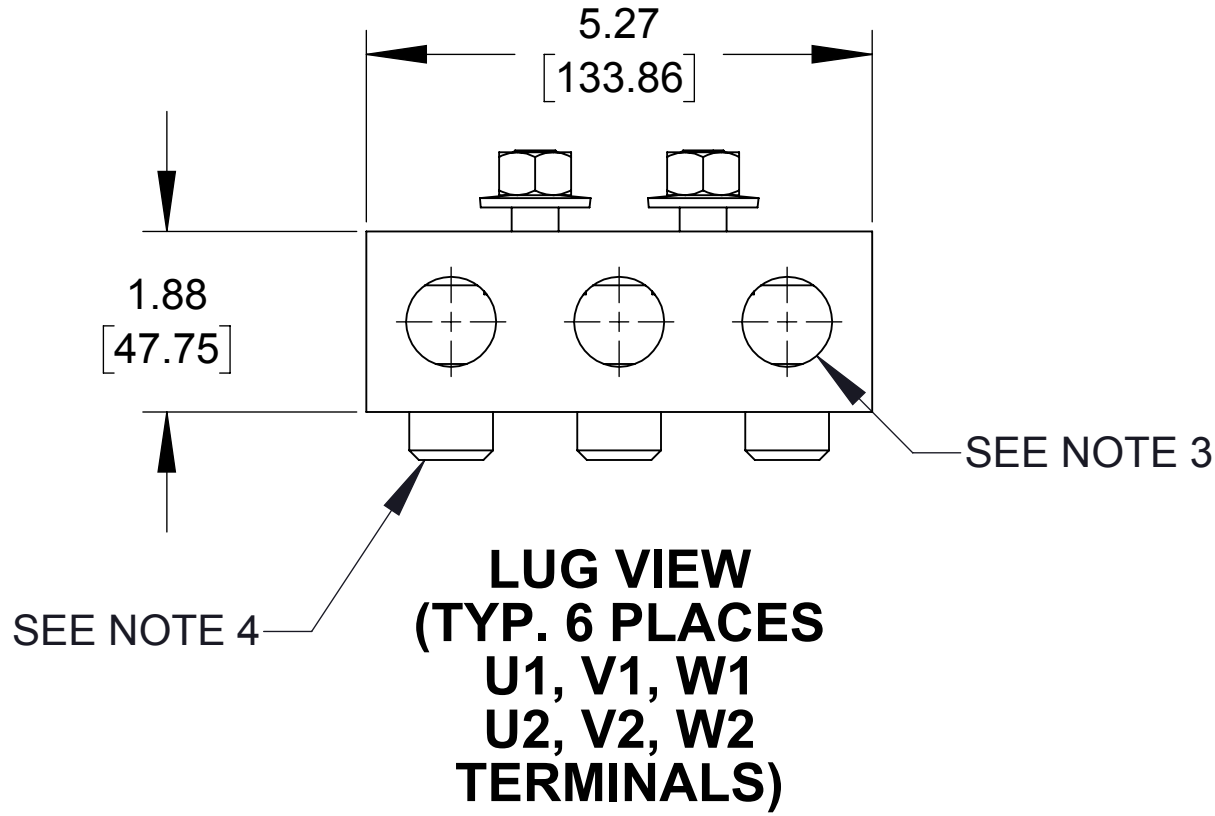

CUSTOMER CONNECTION
DETAIL VIEW (THERMAL)

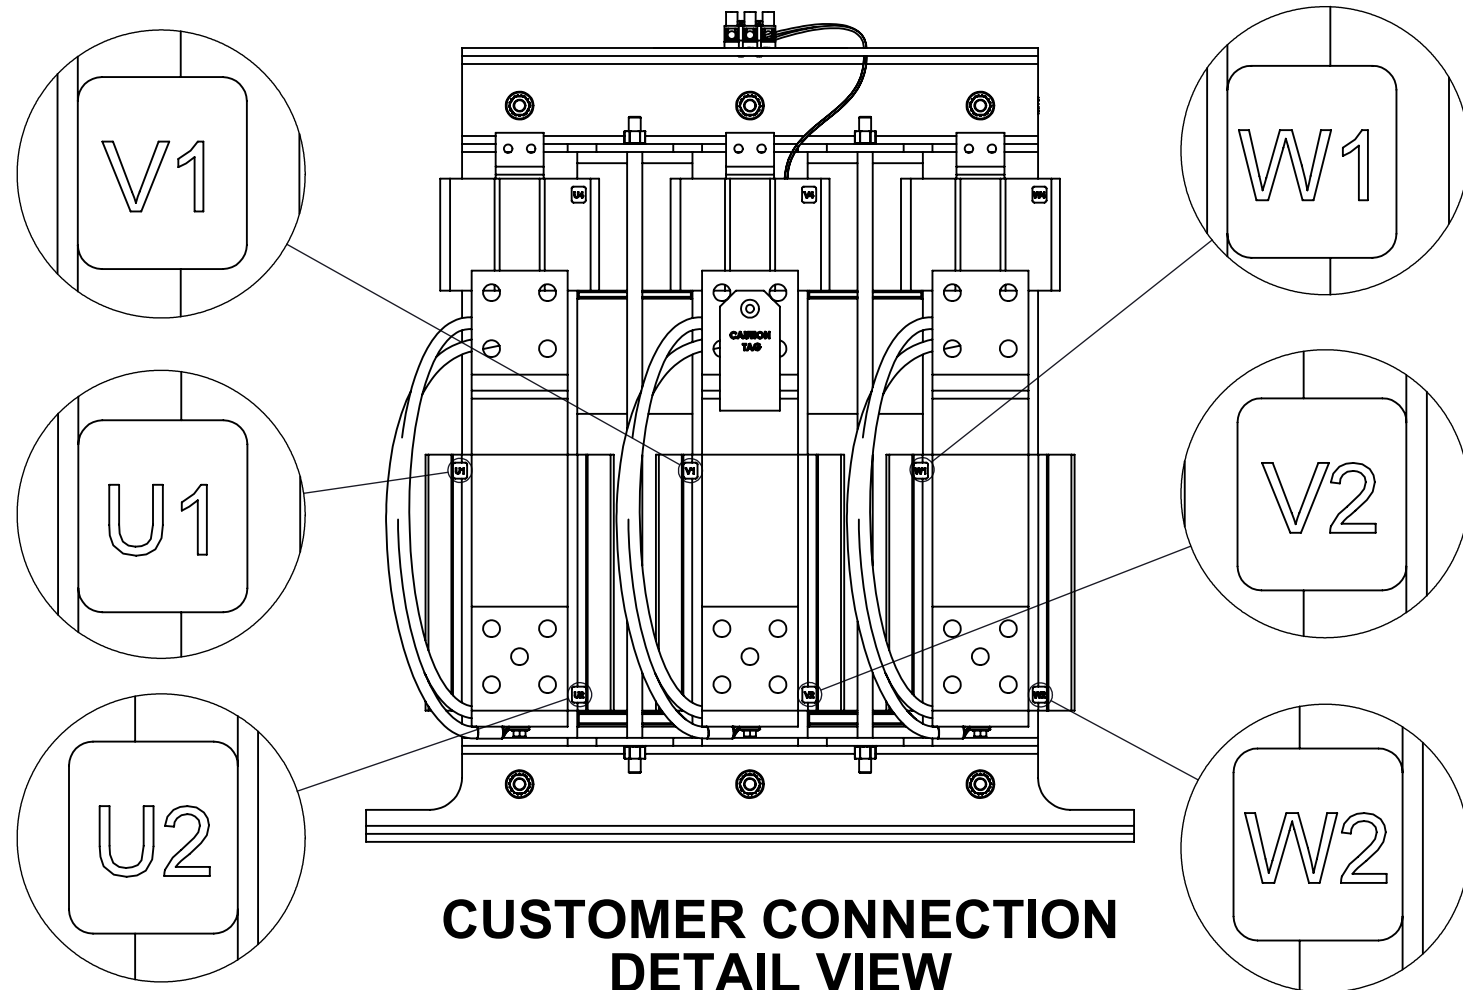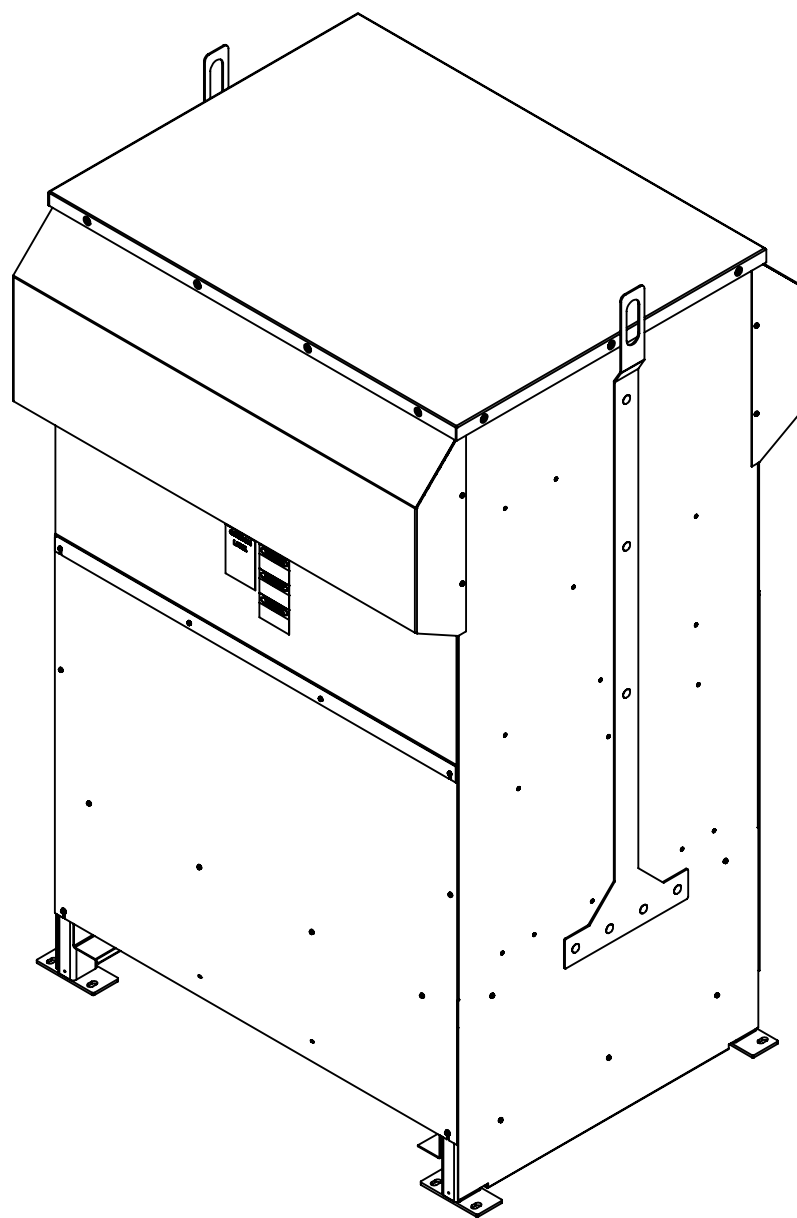

CUSTOMER CONNECTION
DETAIL VIEW
(WITH LUGS REMOVED)

NOTES:

1. TIGHTEN TERMINAL BLOCK SCREWS TO 16 IN/LBS. TORQUE
2. TERMINAL WIRE RANGE: 4 - 14 AWG
3. TERMINAL WIRE RANGE: 500 MCM - 1000 MCM
4. TIGHTEN TERMINAL BLOCK SCREWS TO 600 IN/LBS. TORQUE

THE COMPONENT, PART OR ASSEMBLY DESCRIBED IN THIS DOCUMENT MUST COMPLY WITH THE EU (EUROPEAN UNION) DIRECTIVE RoHS2		MATERIAL		CONFIDENTIAL AND PROPRIETARY INFORMATION THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF MTE CORPORATION AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF MTE CORPORATION		
CONTAINS <0.1% OF ANY SVHC BY WEIGHT PER REACH REGULATION				DESCRIPTION		
UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES [MM] TOLERANCES ARE: ANGLES: $\pm 1^\circ$ 1 PLACE .X: $\pm .1 [2.5]$ 2 PLACE .XX: $\pm .01 [0.25]$ 3 PLACE .XXX: $\pm .005 [0.127]$		DRAWN KV CHECKED JM APPROVED JM		DATE 03/31/15 DATE 12/09/15 DATE 12/09/15		
		N83 W13330 Leon Road Menomonee Falls, WI 53051 USA 800.455-4683 262.253-8200		SIZE D DWG No. CD SWGW1500D REV 01		
				SCALE 1:8 SHEET 1 OF 1		